

Exploring the Efficiency of Renewable Energy-based Modular Data Centers at Scale

Jinghan Sun^{†*}, Zibo Gong^{†*}, Anup Agarwal[‡], Shadi Noghabi[§], Ranveer Chandra[§], Marc Snir[†], Jian Huang[†]

[†] University of Illinois Urbana-Champaign
{js39, zibog2, snir, jianh}@illinois.edu

[‡]Carnegie Mellon University
anupa@andrew.cmu.edu

[§]Microsoft Research
{Shadi.Noghabi, ranveer}@microsoft.com

Abstract—Modular data centers (MDCs) that can be placed right at the energy farms and powered mostly by renewable energy, are proven to be a flexible and effective approach to lowering the carbon footprint of data centers. However, the main challenge of using renewable energy is the high variability of power produced, which implies large volatility in powering computing resources at MDCs, and degraded application performance due to the task evictions and migrations. This causes challenges for platform operators to decide the MDC deployment.

To this end, we present SkyBox, a framework that employs a holistic and learning-based approach for platform operators to explore the efficient use of renewable energy with MDC deployment across geographical regions. SkyBox is driven by the insights based on our study of real-world power traces from a variety of renewable energy farms – the predictable production of renewable energy and the complementary nature of energy production patterns across different renewable energy sources and locations. With these insights, SkyBox first uses the coefficient of variation metric to select the qualified renewable farms, and proposes a subgraph identification algorithm to identify a set of farms with complementary energy production patterns. After that, SkyBox enables smart workload placement and migrations to further tolerate the power variability. Our experiments with real power traces and datacenter workloads show that SkyBox has the lowest carbon emissions in comparison with current MDC deployment approaches. SkyBox also minimizes the impact of the power variability on cloud virtual machines, enabling rMDCs a practical solution of efficiently using renewable energy.

I. INTRODUCTION

Data centers today consume more than 2% of total U.S. power [1] and emit even more carbon than the aviation industry [66]. As a result, major datacenter vendors have to purchase carbon credits to temporarily offset the carbon impact of data centers [39], [61], [79]. However, this can only temporarily mitigate the carbon impact of data centers. To curb the carbon footprint of data centers at scale, a promising long-term solution is to rely more on renewable energy sources (e.g., solar and wind) as opposed to non-renewable sources (e.g., oil and gas), especially considering the recently reduced cost of renewable energy [2], [47]. However, the key challenge of utilizing renewable energy is their variability across time and space. For instance, solar power production varies across time and the geographical locations.

*Equal contribution.

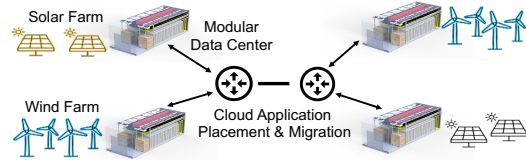


Fig. 1: The target system architecture of SkyBox. It facilitates the deployment of renewable energy-based modular data centers (rMDCs) across multiple geographical regions at scale.

To manage the variability of renewable energy production, two common approaches have been explored. The first approach is to transmit energy (a mix of renewable and non-renewable energy) via transmission lines to data centers. This approach incurs significant monetary cost, additional carbon footprint, and increased complexity of power management due to the uncontrollable mix of renewable and non-renewable energy sources [2]. Specifically, about half of the cost is due to the power transmission and distribution [30]. As an alternative, batteries are used to store power and supply at a later time. However, the battery storage is expensive for large-scale datacenter deployment and they are minuscule in scale [65]. For instance, the battery capacity in the US is only 0.4% of the overall solar and wind capacity [15], [27].

To address these issues, both the academic and industry community [18], [29], [32], [62] proposed to co-locate data centers with renewable farms and powering data centers using renewable energy (Figure 1). We define them as renewable energy-based modular data centers (rMDCs) in this paper. The rMDCs can alleviate the heavy use of batteries and power transmission lines, and have a great potential to achieve zero emissions. Moreover, modular data centers have low construction cost, and offer great mobility across different regions [11], [32], [36]. We have also seen that many datacenter vendors have been planning to deploy rMDCs to meet the increasing demands on cloud computing from customers while achieving the carbon-free goal [5], [29], [38], [62].

As we deploy modular data centers, we still suffer from the challenges caused by the variability of renewable energy produced in each renewable energy farm. To this end, we develop SkyBox, a framework that uses a holistic and learning-based approach to enabling the efficient use of renewable energy with rMDC deployment at scale.

With SkyBox, we aim to answer three research questions: (1) where to deploy rMDCs across geographical regions? (2) how to maximize the efficiency of renewable energy sources across multiple rMDCs? and (3) how to enable smart application placement and migrations across rMDCs to minimize the performance impact of the power variability of renewables. By answering them, we wish SkyBox will facilitate the deployment and operation of rMDCs at scale.

We drive the design of SkyBox with three main observations based on our study of the distribution and production patterns of energy sources generated at more than 500 energy farms in total. We first observe that not all renewable farms are good candidates to place rMDCs as some farms consistently do not have enough stable power output. Second, the power production can be complementary across multiple geographically distributed energy farms, and their aggregate power is more stable than each individual site. Third, while the variability is high, renewable energy production is predictable for a reasonable prediction horizon (i.e., 3–24 hours). This offers sufficient time for datacenter operators to identify power changes in advance, such that they can migrate workloads hours ahead for tolerating the power variability.

SkyBox develops three major techniques for facilitating the rMDC deployment and operations. It first quantifies the coefficient of variation of the power production of renewable energy farms based on their historical traces. This enables datacenter operators to identify the sites that have relatively stable power supply and capacity (§IV-B). After that, SkyBox develops a dynamic subgraph identification algorithm that can group individual renewable energy farm sites into subgraphs. Within the same subgraph, the power production pattern of each renewable energy farm is complementary. Therefore, the subgraph will deliver stable aggregated power production as a whole (§IV-C). Based on the identified subgraph, SkyBox helps datacenter operators decide the sites for deploying rMDCs. SkyBox also develops a Mixed-Integer Program (MIP) model for enabling optimized placement and migration of virtual machines (VMs) to further minimize the impact of the power variability on application performance (§IV-D).

We evaluate SkyBox with the power traces collected from hundreds of renewable energy farms, and VM traces from modern data centers. We show that, with careful selection of rMDC sites and subgraphs, and proper placement of VMs in rMDCs, SkyBox can reduce the total carbon footprint by 46% with low VM migration frequency, in comparison with conventional datacenter deployment approaches. Thus, we believe SkyBox can complement current data center architectures to meet the compute demand in a more sustainable manner.

As modular data centers have lower construction cost compared to conventional data centers, in combination with the minimal use of batteries, SkyBox helps datacenter vendors identify the rMDCs deployment that incurs low embodied carbon footprint. With its minimized usage of the power grid, it also has minimal operational carbon footprint. As SkyBox utilizes the aggregated power production of a few stable energy farms, it minimize the overprovisioning of power and com-

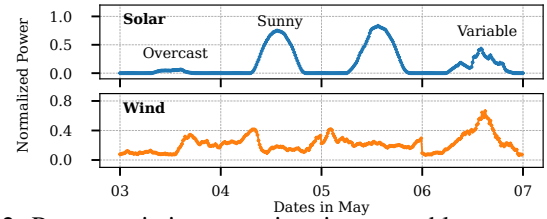


Fig. 2: Power variation over time in renewable energy farms.

pute resources, which further reduces both the embodied and operational carbon emission. Overall, we make the following contributions in the paper:

- We conduct a characterization study of renewable energy with power traces from real-world energy farms (§II).
- We design a site-pruning technique using historical traces to locate viable renewable sites that fit for rMDCs (§IV-B).
- We propose a subgraph identification technique that can identify small complementary subgroups of energy farms based on the prediction of their power variability (§IV-C).
- We develop optimization techniques for smart VM placement and migration to minimize the negative impact of power variability on VM performance and maximize the efficiency of rMDCs (§IV-D).
- We implement SkyBox framework to facilitate the deployment of rMDCs at scale, and conduct a detailed evaluation using real-world renewable energy and VM traces (§V).


II. CHARACTERIZATION OF RENEWABLE ENERGY

To motivate the design of SkyBox, we first characterize the variability of renewable energy sources. We quantify the variability of two main renewable energy sources, solar and wind, by analyzing two representative years-long datasets: (1) EMHIRES dataset [37], [46] with traces from 555 sites in Europe and (2) ELIA dataset [25] from 25 sites in Belgium that includes per-site power production traces and forecasts.

As expected, we observe significant variation across space (different farm locations), time (times of the day and seasons), and power resources (solar and wind). Figure 2 shows a 4-day sample of solar production, normalized to the maximal energy production capacity. Solar energy follows a periodic diurnal pattern, but days overcast with heavy clouds can significantly reduce the peak production (3.5% vs. 77% in the following day), and days with variable cloud patterns cause spiky energy production. And different energy sources exhibit different patterns. The wind energy production for the same duration exhibits sharp peaks and valleys (depending on the weather conditions), but rarely drops to zero.

A. Complementary Variability Patterns

Despite the large variability in a single renewable energy farm, we observe that these variability patterns are often complementary among different energy farms across a geographical region. This complementary pattern can be generated by using different energy sources (e.g., wind vs. solar), and geographical locations with different impacts of microclimates and weather (e.g., the same solar source but in two different locations, one of which is covered by clouds).

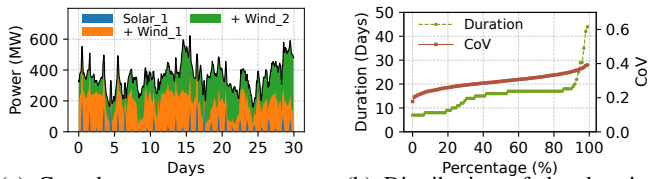

(a) Complementary power production pattern of three sites.

(b) Distribution of the duration of the complementary patterns.

Fig. 3: Reducing the variability in renewable energy production by aggregating multiple sites.

Figure 3a demonstrates such an example from the EMHIREs dataset. To gauge the variability of power produced over time, we use the coefficient of variation (CoV) of renewable power produced at different timestamps as the metric. CoV is the standard deviation divided by the mean, so a higher CoV implies more variability. In Figure 3a, by combining the energy sources from one solar farm (Solar_1) and one wind farm (Wind_1) we deliver more stable energy than the single solar farm ($5.6\times$ lower CoV). Adding another wind farm (Wind_2) further reduces the variability and decreases the value of CoV by an additional $1.5\times$. Thus, we reach that:

Observation 1: *Power variability in renewables can be masked by selecting a subgroup of complementary sites.*

We further analyze how long the complementary sites can remain complementary. We define a group of sites as complementary sites if their aggregated power production is stable ($\text{CoV} < 0.4$) for at least one week. Our results show that the complementary sites remain stable for 14.4 days on average and up to 44 days, as shown in Figure 3b. For the example shown in Figure 3a, the three renewable sites can maintain a complementary pattern for 30 days. Therefore, our analysis suggests that we can re-identify complementary sites periodically but not frequently.

Observation 2: *The complementary sites could preserve the complementarity for 2 weeks on average and up to 6 weeks.*

B. Predictability of Renewables

The main cause of power variability is the weather condition, which can be predicted accurately a few hours ahead. We show the power forecasts provided in the ELIA dataset [25] (based on the weather forecasts) in Figure 4. The predictions for near-future power production are accurate enough to capture important trends. The mean absolute percentage error (MAPE) for the next 3-hour predictions is 8.5–9.0%, for day-ahead predictions is 18–25%, and for week-ahead predictions is 44%–75%. This predictability provides insights into how the power resources will change, and when will workload migrations be needed (see the detailed discussion in §IV-D). As the power changes can be predicted within several hours to one day ahead, we have sufficient time to migrate applications to tolerate the power variability further.

Observation 3: *Renewable energy is predictable for a reasonable prediction horizon (3–24 hours) in the future.*

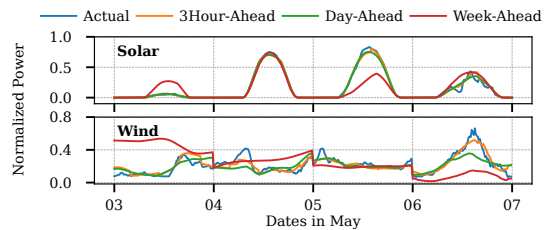


Fig. 4: Energy prediction of solar and wind in near (3-hour and day-ahead) and far-away future (week-ahead).

TABLE I: A summary of the core components in a modular data center, and their cost and characteristics.

Modular DC	Server Rack	Cooling	Battery
Power (kW)	150	35	-
Embodied Footprint (tCO_{2e})	88.7	3.7	5.5
Cost (\$)	450K	10.9K	46.9K
Footprint (m²)	20.6	5.8	5.8
Capacity	10 racks	-	15 mins

III. TECHNICAL BACKGROUND

To facilitate our discussion, we now present the essential technical background of modular data centers.

A. Modular Data Centers

Modular data centers (MDCs) attract much attention from datacenter vendors, as they have low construction cost and installation time [44], [73], [83]. An MDC organizes the server racks, cooling system, power supply, and batteries in one or more containers, which provides convenience for installation and shipping. In Table I, we list the configurations and costs of an example MDC FusionModule-2000 [78]. A typical MDC consists of 10 racks (each rack with 15 servers), 3 battery cabinets with a default 15-minute backup time, and 3 cooling containers. Among all the components, server racks take a major portion of the embodied carbon (i.e., carbon emission of manufacturing, construction, and shipping), installation cost, and building footprint. The battery cabinets have less installation cost and building footprint, as they are usually used for emergency backups with a small capacity.

B. Renewable Energy-based MDCs

MDCs are well-suited to collocate with renewable energy farms for their flexibility and low construction costs. Major datacenter providers have recently invested in building rMDCs that can be easily deployed alongside renewable energy farms [45], [59]. However, the key challenge with collocation is the variability of the renewable energy production (see §II). To cope with this, current studies usually leverage batteries and/or power grids. We discuss their pros and cons as follows.

Batteries. Batteries can tolerate the volatility of renewable power supply [2], [58], [80] by storing the surplus renewable energy and discharging it when the renewable power is insufficient. However, deploying batteries in rMDCs faces two critical challenges. First, the current rMDC battery capacity is insufficient to tolerate the renewable energy production variation (up to several hours). Second, increasing the battery size will increase the cost and building footprint. Considering the commercial-scale battery (\$1250/kWh [65]) with a one-hour backup time (for servers in Table I), the hardware and

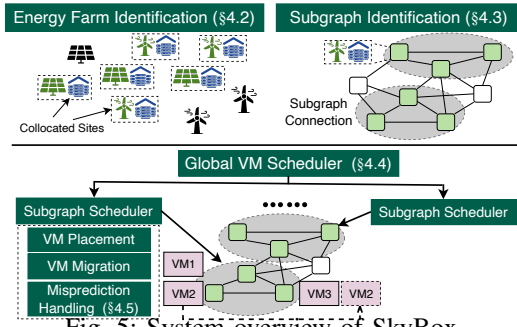


Fig. 5: System overview of SkyBox.

installation cost accounts for $>30\%$ of the total rMDC cost, and the building footprint reaches $>40\%$ of the total footprint. Therefore, it is less practical to fully rely on batteries to tolerate long-lasting renewable power supply fluctuations.

Power grid. The power grid serves as a backup energy source for rMDCs as it is a more stable power supply. Drawing energy from the power grid helps the rMDC keep servers running when the renewable power supply drops. However, the grid mainly supplies power from non-renewable energy sources today, which have significantly larger carbon intensity [41]. Therefore, extensive power grid use will increase the operational carbon footprint of the rMDC.

IV. DESIGN AND IMPLEMENTATION

The goal of SkyBox is to best utilize renewable energy when collocating MDCs with renewable energy farms, while minimizing the negative impact on application performance. SkyBox maximizes the use of renewable energy for rMDCs and minimizes the use of power grid and batteries to reduce carbon emissions when renewable energy is insufficient.

A. SkyBox Overview

SkyBox has four core components as shown in Figure 5.

Identification of renewable energy farms: To decide where to deploy rMDCs, SkyBox uses the stability of power supply as the key metric. By collocating rMDCs with stable renewable energy farms, it ensures a reliable power supply while reducing embodied carbon by overprovisioning fewer servers (§IV-B).

Subgraph identification of complementary sites: Our study reveals that a small group of renewable energy farms with complementary patterns can produce stable aggregated power supply (§II-A). SkyBox identifies a set of subgraphs from the selected rMDCs, where each of them has complementary renewable energy sources. With the subgraph candidates, we select ones with the stablest power supply (§IV-C).

VM placement and migration: Since each individual rMDC of a stable subgraph may still face power variability, SkyBox performs optimized VM placement and migration within the subgraph. Utilizing the predictability of renewable energy production (see §II-B) and VM characteristics (e.g., lifetime) [43], SkyBox can place VMs on more stable rMDC and perform VM migrations from rMDCs with insufficient power to those with excessive power. This minimizes the power grid usage, and thus reduces the operational carbon footprint (§IV-D).

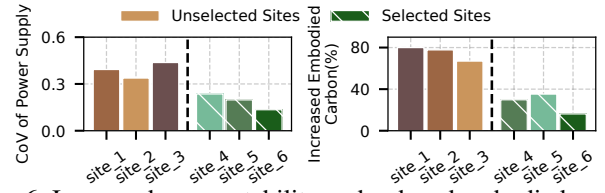


Fig. 6: Improved power stability and reduced embodied carbon footprint with selected energy farms (lower is better).

Misprediction handler: Predictions of the future power supply and VM lifetime may incur misprediction errors. SkyBox gracefully handles the mispredictions with minimal overhead. We will discuss the details in §IV-E.

B. Identification of Energy Farms for rMDCs

SkyBox first decides which renewable energy farm to collocate with each rMDC. There exists a large number of renewable energy farms, but not all of them are suitable to deploy rMDCs. This is because different farms have different levels of power variability. SkyBox prefers renewable energy farms with stable power supply for two major reasons.

First, collocating rMDCs with stable farms guarantees higher resource availability, which reduces the power grid usage and incurs less VM outages. Second, the collocation scheme helps reduce the embodied carbon footprint and the demand for batteries. This is because rMDC with a higher power supply fluctuation has to overprovision additional server capacity to utilize the peak renewable energy production. rMDCs with more stable power supply require less server capacity and battery capacity, therefore mitigating the embodied carbon footprint and construction cost.

SkyBox uses the coefficient of variation (CoV) of the power production as the key metric to rank the farms. Figure 6 (left) shows the CoV of the three selected energy farms is much less (51%) than that of the selected energy farms. In comparison with rMDCs supplied with stable power sources (e.g., power grid), Figure 6 (right) shows the additional embodied carbon cost of building rMDCs of these selected farm sites is much less than that of unselected farms (see the detailed procedure of calculating carbon emissions in §V-A). This is because these rMDCs need less servers for the overprovisioning for tolerating the power variability of collocated energy farms. Although SkyBox causes embodied carbon footprint for constructing rMDCs, it significantly reduces the total carbon emissions for rMDCs by reducing the operational carbon footprint (see §V).

C. Complementary Subgraph Identification

In §IV-B, we identify a set of renewable energy farms with stable power supply to collocate with rMDCs. However, three major challenges remain. First, managing these rMDCs across multiple geographical regions will be complicated. It brings challenges to datacenter operators, especially considering the diverse power production patterns at different farms. Second, the selected farms individually cannot constantly generate stable power production over time. Third, as cloud providers place their VM workloads across all the rMDCs, the decision space could be extremely large. An ill-judged decision could

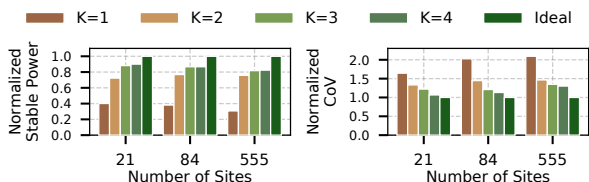


Fig. 7: The impact of different subgraph size K . It shows the normalized stable aggregated power and its average CoV.

cause the inefficiency of VMs, and even unexpected VM outages due to the unstable power supply.

Key idea: To address those challenges, we identify disjoint subgraphs from these rMDCs. Each subgraph has a subset of renewable energy farms. To build a subgraph, we use three metrics: (1) *the CoV of the aggregated power production*; (2) *the minimum power production of the farms*; and (3) *the distance between sites*. The first and second metrics are based on the historical power production of each farm. They guarantee that we select the subgraphs with sufficient and stable aggregated power supply. The third metric ensures the selected subgraphs have low communication overheads. It is configurable, and we set the upper bound as 500 miles by default. We enumerate all possible subgraphs and rank them using the three metrics. We iterate through the set of subgraphs in the rank order and select the subgraph that has no intersection with previously selected subgraph. After that, we have a set of subgraphs that have complementary patterns.

Key study results: Exhaustively enumerating all the subgraph candidates can lead to non-trivial overhead, since the number of subgraph candidates grows combinatorially as we increase the number of farm sites and the size of subgraphs. Ideally, we wish to minimize the size of subgraphs, while retaining the complementary benefits, which can simplify the power management and task scheduling across data centers.

Small subgraphs are sufficient for rMDC deployment:

According to our study of the 555 farms, we find that small subgraphs with three sites have complementary power patterns, and can provide a sustained power capacity. We show the aggregated power and average CoV of the power with different subgraph sizes in Figure 7. In the best case (Ideal in Figure 7), all farm sites are grouped into a single subgraph and it has the highest stable aggregated power and the lowest variability (CoV). As we vary the size of subgraphs in Figure 7, the stable aggregated power of the subgraphs with three sites can reach the 80-90% of the ideal stable power, and its CoV is also comparable to the ideal case. As we further increase the subgraph size, we will enlarge the exploration space without significant benefits. Therefore, we set the subgraph size to be three by default for the studies in SkyBox.

Subgraph identification is a dynamic problem: As the power patterns of a renewable site may change over time. Our study shows that subgraphs usually retain their complementarity for two to six weeks. Therefore, SkyBox can re-identify subgraphs that have complementary power patterns every two weeks for more stable aggregated power supply.

As each subgraph has stable aggregated power supplies from

TABLE II: Input constants of our MIP model.

Symbol	Interpretation
M, D, N, \mathbb{K}_n, T	A set of M regular VMs, D delay-insensitive VMs, N subgraphs, K rMDCs for subgraph n , time interval T
$Power_{mt}$	The power draw of VM m at time t
Mem_m	The memory size of VM m
$Lifetime_m$	The predicted lifetime of VM m
RS_{nkt}	Renewable power supplied to the k th rMDCs of subgraph n at time t
$Power_{Migr}$	Power consumption of migration (per GB VM states)
CI_{NR}, CI_R	Carbon Intensity of non-renewable energy and renewable energy [2]

renewables, datacenter vendors can deploy rMDCs close to renewable energy sites in these subgraphs. Note that datacenter vendors have the choice to select one or more subgraphs for rMDC deployment. They can deploy rMDCs at the farm sites in the selected subgraphs. After the rMDC deployment, we do not need to move the deployed rMDCs (even upon subgraph re-identification). Instead, SkyBox suggests migrating VMs across rMDCs for lower cost (see the details in §IV-D).

D. VM Placement and Migration

After identifying the subgraphs, we now place VMs across these subgraphs and their rMDCs. A simple approach is heuristic-based VM placement, such as greedily placing VMs onto the rMDCs in the order of their resource availability. However, heuristic-based approaches are often suboptimal, especially when the power supply changes over time, and different VMs have different priorities and demands for computing resources. Therefore, it is difficult for heuristic-based approaches to identify the best rMDC for each VM.

SkyBox formulates the VM placement and migration problem into an optimization problem using the Mixed-Integer Program (MIP) model [31]. SkyBox employs the MIP model for three reasons. First, the MIP model can make optimized decisions for a large set of VMs and rMDCs with a global perspective. Second, it can take VM properties (e.g., regular or evictable) into consideration to match each VM with its best-fit rMDC. Third, the MIP model can effectively handle the dynamic power supply patterns of rMDCs by leveraging the predictability of renewable power supply to find optimized solutions in advance. We present the VM placement and migration policies using a hierarchical approach as follows.

VM placement among subgraphs: SkyBox first relies on heuristic-based approaches for VM placement across subgraphs. This is because the aggregated power supply of each subgraph is relatively stable. We empirically find that the heuristic-based approach can handle such scenario well. Specifically, SkyBox employs the best-fit placement algorithm. We maintain a list of subgraphs ordered by the amount of excess power. When a VM arrives, we place it on the subgraph with the highest amount of resource available. If the subgraph has no excess power supply, we remove it from the list.

VM placement among rMDCs in a subgraph: After identifying the suitable subgraph, SkyBox decides where to place the VM among rMDCs within each subgraph. Since the renewable power supply for each individual rMDC is less stable than the aggregated power supply of each subgraph, the VM placement

problem across rMDCs is more dynamic. Therefore, we do not use a heuristic-based approach, but instead formulate it into an optimization problem using the MIP model. We define the input constants and variables of MIP model in Table II and Table III, respectively, and explain them below.

$$\text{O1 Carbon: } \min \sum_{n \in \mathbb{N}, k \in \mathbb{K}_n, t \in \mathbb{T}} NR_{nkt} \cdot CI_{NR} + RU_{nkt} \cdot CI_R \quad (1)$$

$$\text{O2 Uptime: } \max \sum_{m \in \mathbb{D}} \frac{Lifetime_m}{Lifetime_m + Downtime_m}, \quad \text{s.t.}$$

$$\text{C1 Power: } \forall n \in \mathbb{N}, k \in \mathbb{K}_n, t \in \mathbb{T} :$$

$$RU_{nkt} \leq RS_{nkt}$$

$$Consum_{nkt} = NR_{nkt} + RU_{nkt} = \sum_{m \in \mathbb{M} \cup \mathbb{D}} X_{mnt} \cdot Power_{mt}$$

Formula 1: The key objectives and constraint of MIP model.

MIP input: The MIP model takes the following inputs: (1) VM resource configuration, including its memory size (Mem_m), its VM category (regular or evictable¹), and its power consumption ($Power_{mt}$), which can be estimated by the number of vCPUs and its utilization [48]; (2) Estimated VM lifetime ($Lifetime_m$), based on the insights from prior studies [8], [20], [43] that VM lifetime can be estimated with high accuracy using VM properties (e.g., VM type and hosted application type); (3) Current and predicted power supply of rMDCs (RS_{nkt}), with the high predictability of renewable power supply (see §II-B). SkyBox has the strong robustness of handling mispredictions, as discussed in §IV-E and §V-G.

MIP output: For VM placement within subgraphs, the MIP model denotes placement decisions as X_{mnkt} (see Table III). It sets $X_{mnkt} = 1$, if VM m is powered on at k th rMDC in subgraph n at time t . The MIP model can also decide the non-renewable energy usage from the power grid. We use NR_{nkt} to represent the amount of non-renewable power supply to the k th rMDC in subgraph n at time t .

MIP objectives: SkyBox aims to minimize the total carbon footprint and maximize the VM uptime. To achieve these goals, we define two objectives in our MIP model. The first objective (O1 Carbon in Formula 1) is defined to minimize the non-renewable energy usage of rMDCs over the course of time, since it is the primary cause of the operational carbon footprint. The second objective maximizes the uptime percentage for evictable VMs (O2 Uptime). As for regular VMs, SkyBox guarantees that they will never be actively powered off due to the insufficient renewable power supply.

MIP variables and constraints: We list the key constraint of our MIP model in Formula 1. It enforces that the total power consumption of all running VMs ($Consum_{nkt}$) on each rMDC cannot exceed the total power supply (C1 Power).

VM migration across rMDCs in a subgraph: If an rMDC experiences a decrease of renewable power supply, SkyBox can migrate some of its VMs to another rMDC within the same subgraph that has excessive power supply. Therefore, we integrate a power model to quantify the overhead of VM migration, where its power consumption is proportional to the

¹Cloud platforms usually offer evictable VMs that run at a much lower price and priority than regular VMs. They can be evicted if needed [4], [60].

TABLE III: Variables used in our MIP model.

Symbol	Domain	Interpretation
X_{mnkt}	$\{0, 1\}$	Whether VM m is powered up in the k th rMDC of the subgraph n at time t
$M_{mnk_1k_2t}$	$\{0, 1\}$	Whether VM m is migrated from the rMDC k_1 to k_2 of the subgraph n at time t
NR_{nkt}	$\mathbb{R}_{\geq 0}$	Non-renewable power used by the k th rMDCs of the subgraph n at time t
RU_{nkt}	$\mathbb{R}_{\geq 0}$	Renewable power used by the k th rMDCs of the subgraph n at time t
$Consum_{nkt}$	$\mathbb{R}_{\geq 0}$	Power consumption in the k th rMDCs of the subgraph n at time t
$Downtime_m$	$\mathbb{R}_{> 0}$	The actual downtime of VM m

TABLE IV: Misprediction handling for different scenarios.

ID	VM Lifetime	Renewable Power	Possible Exceptions
①	Over-predict	Under-predict	N/A
②	Over-predict	Over-predict	Power Deficiency
③	Under-predict	Under-predict	Power Deficiency, Extra VM Lifetime
④	Under-predict	Over-predict	Power Deficiency, Extra VM Lifetime

size of VM states migrated [54]. Larger VMs incur higher overhead and are more sensitive to migrations.

Additional MIP output: VM migration is represented by $M_{mnk_1k_2t}$ (Table III) in our MIP model. $M_{mnk_1k_2t}$ denotes whether a VM m should be migrated from k_1 th rMDC to k_2 th rMDC of subgraph n at time t . Using the same objectives (O1 and O2), the MIP model will identify an optimized VM migration plan for each rMDC.

Additional MIP variables and constraints: The MIP model uses $M_{mnk_1k_2t}$ and input constant $Power_{Migr}$ to estimate the migration overhead of a VM m . For each VM, its migration overhead counts toward the total power consumption of both migration source and target rMDC (C1' Power of Formula 2). Following the prior constraint (C1 Power), the total consumption cannot exceed the power supply.

$$\text{C1' Power: } \forall n \in \mathbb{N}, k \in \mathbb{K}_n, t \in \mathbb{T} :$$

$$Consum_{nkt} = \sum_{m \in \mathbb{M} \cup \mathbb{D}} [X_{mnkt} \cdot Power_{mt} + Power_{Migr} \cdot Mem_m \cdot (\sum_{k_1 \in \mathbb{K}_n} M_{mnk_1kt} + \sum_{k_2 \in \mathbb{K}_n} M_{mnk_2kt})] \quad (2)$$

Formula 2: The additional constraint of the MIP model.

E. Misprediction Handling

Our MIP model relies on the prediction of renewable power production and VM lifetimes, which may be slightly inaccurate. For instance, a 3-hour-ahead prediction has 9% error on average. In SkyBox, minor prediction errors are tolerable. While the actual power supply of an rMDC may be lower than predicted, it may still exceed the actual power consumption. And large mispredictions may cause extra power grid usage or evictable VM outages. Therefore, we design a misprediction handling mechanism to minimize their impact.

We categorize the misprediction into two types: under-prediction and over-prediction, where an under-predicted value is smaller than its actual value, and vice versa. For example, an under-predicted power production means more actual power is produced than predicted, and an over-predicted VM lifetime means the VM's actual lifetime is shorter than predicted. We

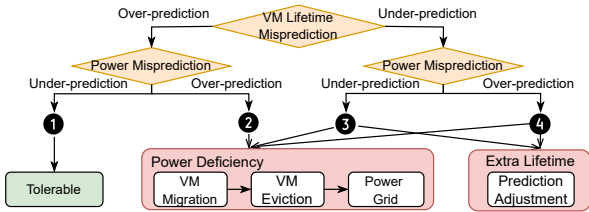


Fig. 8: The misprediction handling mechanisms of SkyBox.

present different misprediction scenarios in Table IV, and the workflow of misprediction handling in Figure 8.

In ❶, the actual VM lifetime is shorter than predicted, and the actual power supply is larger than predicted. Based on the predicted values, the MIP model may place fewer VMs on the rMDC than it can actually support, and these VMs may run shorter than its predicted lifetime. In this case, the power consumption never exceeds the power supply. The rMDC will have excessive power, and it can serve as the migration target of other rMDCs. Thus, no specific handling needed for it.

In ❷, both the VM lifetime and the renewable power supply are over-predicted. Since the power supply is over-predicted, our MIP model may place more VMs on the rMDC than that it can support, resulting in a power deficiency at the rMDC (i.e., the power supply at an rMDC cannot meet its total power consumption). To handle this, we employ three techniques: *VM migration*, *evictable VM shutdown*, and *power transmission from the grid*. First, we prioritize VM migration since it introduces minimal VM downtime and carbon overhead. To perform migration, we select another rMDC which has the most excessive power supply in the same subgraph as the migration target. If such an rMDC exists, we will migrate VMs to this target rMDC until it cannot host more VMs, or the power consumption of the source rMDC falls below the power supply. We prioritize the VMs with less amount of VM states to migrate, as they incur lower migration overheads. If the power consumption still exceeds the power supply, we will power off evictable VMs until their VM uptime percentage is below a predefined threshold (empirically set to 90%). Finally, we will use the power grid if still necessary.

In ❸, the actual VM lifetime is longer than its prediction. The MIP model might place VMs onto the rMDC that does not have sufficient power supply for its entire lifetime. This problem can be handled with similar mechanisms in ❷. Since the MIP model receives the under-predicted VM lifetime as its input, it cannot make placement and migration decisions for the rest of their actual lifetimes. To handle this issue, SkyBox adds an offset to the VM lifetime prediction when we detect that it is under-predicted. This offset is adjusted using the average difference between the predicted and the actual lifetime of completed VMs.

In ❹, it may incur similar problems caused by over-predicted power supply in ❷ and under-predicted VM lifetime in ❸. We handle them in the same way as discussed above.

TABLE V: Key parameters used in the evaluation of SkyBox.

Category	Component	Value	Lifetime
Cost [9], [11], [65]	Server	\$3,000 per server	4 years
	Battery	\$1,250 per kWh	10 years
	Power Trans.	\$300K per km	20 years
	Construction (Cooling, electricity, etc.)	\$10 per watt	20 years
Carbon Intensity [41]	Solar	41 gCO ₂ eq per kWh	-
	Wind	11 gCO ₂ eq per kWh	-
	Brown	700 gCO ₂ eq per kWh	-
Embodied Footprint [26], [28], [69]	Server	591 kgCO ₂ eq per server	4 years
	Battery	146 kgCO ₂ eq per kWh	10 years
	Cooling Facility	50 kgCO ₂ eq per m ²	20 years

F. SkyBox Implementation

We develop SkyBox framework by enabling the replay of the power variations for each rMDC with real-world power traces¹ from renewable energy farms, and the replay of the VM execution and migration across rMDCs with real-world VM traces from data centers [6]. It takes renewable power traces and VM traces as its inputs and replays the power supply in each rMDC and the VM events (i.e., VM deployment, migration, or shutdown). We measured the VM migration overheads for different types of VMs in real servers (§IV-D). At runtime, SkyBox updates the power production at each rMDC, triggers VM placements, and decides VM migration. We use Gurobi [42] to implement our MIP model for VM placement and migration, the MIP model uses a 3-hour-ahead prediction for its inputs such as the future power supply. The migration decisions of each subgraph are executed concurrently.

V. SKYBOX EVALUATION

Our evaluation shows that: (1) SkyBox reduces the total carbon footprint by 46% (§V-B) with reduced monetary cost (§V-C), and minimizes its impact on VMs, compared with baseline rMDC placement policies (§V-D); (2) It remains performant with large-scale rMDCs deployment, different battery capacities, and various VM workloads (§V-E); (3) It minimizes the use of power grid for reduced carbon emissions (§V-F); and (4) it shows strong robustness to the mispredictions of renewable power production and VM lifetime (§V-G).

A. Experimental Setup

We use the EMHIRES dataset [37], [46] to obtain the power production data of renewable farms. Similar to the prior work [34], [35], we take a constant portion of the power generated from each renewable energy farm, such that its maximum power capacity equals to the maximum power consumption of rMDC servers. We use the VM workloads from the Azure Cloud Dataset [6]. The dataset has various VM properties, including the VM configurations (e.g., memory size), VM lifetime, and its category (regular or evictable). Their arrival rates maintain a high power utilization (90%) over datacenter servers [34], [35]. By default, the VM dataset has 10% evictable VMs. We also vary the proportion of evictable VMs in our sensitivity analysis (§V-E).

rMDC setup: We first obtain the top six rMDCs based on the CoV of the power supply and group them into two stablest subgraphs (see §IV-B and §IV-C). Each rMDC follows the configurations shown in Table I. We further evaluate SkyBox with an increasing number of rMDCs in §V-E.

Carbon footprint model: We quantify the total carbon footprint with three categories: amortized embodied carbon, operational carbon from the power grid, and operational carbon from renewable energy. The embodied carbon footprint is measured with servers, batteries, and cooling facility, and it is amortized over their lifetime. We list their details in Table V. The operational carbon footprint is measured by the product of total energy consumption (from wind, solar, or power grid) and the carbon intensity (see Table V).

Baseline policies: We compare SkyBox against baseline rMDC placement policies. They differ in the way that rMDCs are placed with multiple energy sources (i.e., renewable energy, battery, and power grid). For all baseline policies, rMDCs prioritize to use the renewable energy and use the power grid as a backup. Note that we do not compare non-renewable-based data centers, as they incur a high operational carbon footprint. We summarize the baseline policies as follows:

- **Centr-Global** deploys a centralized rMDC at the geometric center of all the selected renewable energy farms and connects it to all the farms with power transmission lines.
- **Centr-Graph** is similar to Centr-Global, but it deploys a centralized rMDC per subgraph. They are ideal policies as they can aggregate all the renewable energy into a rMDC.
- **Distr-Grid** co-locates the rMDC with each renewable energy farm. Each rMDC handles its VM workloads independently without migrating VMs.
- **Distr-Battery** adds extra batteries based on Distr-Grid. The battery charges excessive renewable power and discharges when renewable power is insufficient. We set the extra battery capacity of each rMDC such that it can sustain one hour of server operation [49]. We further vary its battery capacity in the sensitivity analysis (§V-E).

SkyBox is similar to Distr-Grid but live-migrates VMs within each subgraph from rMDCs having insufficient power to those with excessive power supply using the MIP model. We also compare SkyBox with its variants to show the benefit of each of its component: **SkyBox-NoSI** uses a random site selection policy; **SkyBox-NoSG** uses random subgraph identification; and **SkyBox-BestEffort** uses the best-effort VM placement policy instead of the MIP model. SkyBox-BestEffort prioritizes migrating VMs to the rMDC with the most excessive power production, suspends evictable VMs if needed, and uses the power grid as the last choice.

B. Carbon Footprint Reduction

We first evaluate SkyBox in reducing the carbon footprint. We show the cumulative carbon footprint of different rMDC placement policies over eight weeks in Figure 10. Compared to Distr-Grid and Distr-Battery, SkyBox produces 46% and 39% less total carbon footprint, respectively. This is because (1) SkyBox groups rMDCs into subgraphs, which share a more stable aggregated power supply than each individual rMDC; and (2) it performs effective VM migration within each subgraph with the predictions of the power supply.

We also compare SkyBox with the two centralized rMDC placement policies: Centr-Global and Centr-Graph. Since

TABLE VI: Breakdown of the amortized monetary cost of different data center placement policies over one year.

Category	Centr-Global	Centr-Graph	Distr-Grid	Distr-Battery	SkyBox
Servers	\$562K	\$614K	\$675K	\$675K	\$675K
Battery	\$23K	\$25K	\$28K	\$141K	\$28K
Power Trans.	\$62M	\$61M	\$45K	\$45K	\$45K
Construction	\$375K	\$410K	\$450K	\$450K	\$450K
Total	~\$63.0M	~\$62.0M	~\$1.2M	~\$1.3M	~\$1.2M

Centr-Global can aggregate all renewable energy production into a centralized data center, it has the most stable power supply. Compared to this ideal placement policy, SkyBox has slightly higher operational carbon, as it incurs extra migration overhead. SkyBox also produces slightly more embodied carbon, as it needs to provision more servers to make use of the peak power supply. Compared to Centr-Graph, SkyBox has almost the same (0.1% more) total carbon footprint. This is because Centr-Graph statically connects rMDCs with the renewable power farms in each subgraph. While these two baseline policies have a similar carbon footprint as that of SkyBox, their monetary costs are several times higher than that of SkyBox (see §V-C), making them less attractive.

SkyBox achieves more carbon footprint reduction, when the power production is unstable. As shown in Figure 9, SkyBox obtains more benefits during the fifth to the seventh week, when the CoV of energy production is high (i.e., 51%-64% reduction compared to Distr-Grid). This is because the baselines require more power grid usage when renewable production is unstable, causing a high operational carbon footprint. In contrast, SkyBox can perform optimized VM placement and migration, which significantly reduces the operational carbon footprint caused by the use of the power grid, as shown in the carbon breakdown in Figure 11.

C. Monetary Cost Reduction

We evaluate the monetary cost of SkyBox amortized over one year, and compare it with the baselines. With the monetary cost breakdown and the expected lifetime for each rMDC component in Table V, we show our study results in Table VI.

SkyBox and Distr-Grid have the minimum monetary cost among all the rMDC placement policies. Distr-Battery has 13% additional costs due to the extra battery capacity. Centr-Global and Centr-Graph have lower server costs since they need fewer deployed servers than SkyBox to reach the same computing capacity. As the centralized data centers aggregate the power supply from multiple renewable energy farms, which generates a smoothed power supply curve, allowing Centr-Global and Centr-Graph to provision fewer servers to make use of their peak power supply. However, Centr-Global and Centr-Graph have to connect all renewable energy farms to the centralized rMDC via power transmission lines, causing higher cost (62× more than SkyBox). Thus, these solutions are less practical in terms of cost efficiency.

D. VM Uptime Improvement

SkyBox improves the overall efficiency of rMDCs as reflected by the evictable VM uptime. Figure 12 presents the tradeoff between evictable VM uptime and their operational

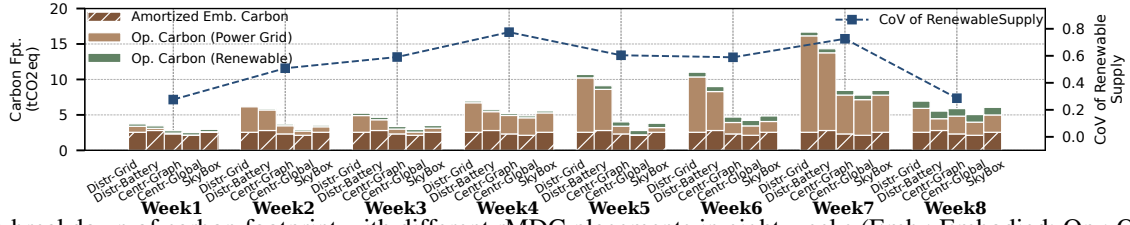


Fig. 9: The breakdown of carbon footprint with different rMDC placements in eight weeks (Emb.: Embodied; Op.: Operational).

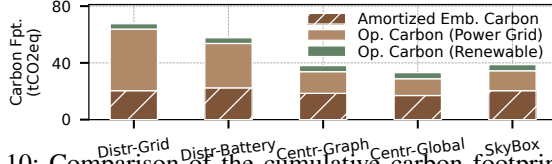


Fig. 10: Comparison of the cumulative carbon footprint with different rMDC placement policies over eight weeks.

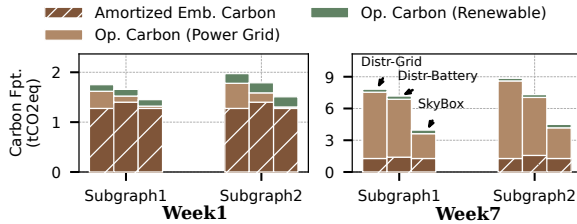


Fig. 11: The breakdown of carbon footprint of each subgraph.

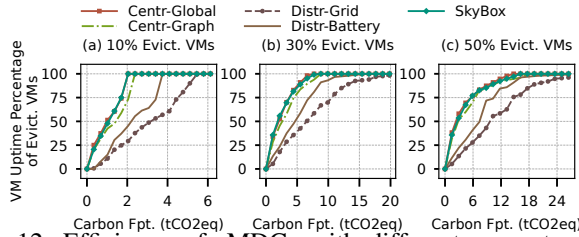


Fig. 12: Efficiency of rMDCs with different percentages of evictable VMs (quantified with evictable VM uptime).

carbon footprint, with different settings of the evictable VMs (from 10% to 50%). With the same operational carbon footprint, SkyBox achieves the similar efficiency as Centr-Global and Centr-Graph. This is because they have relatively stable renewable energy supplies, which minimizes the negative impact (i.e., VM shutdown) on evictable VMs.

SkyBox always delivers better efficiency than Distr-Grid and Distr-Battery. For instance, Figure 12 (left) shows that, when the carbon footprint is 2.0 tCO₂eq, SkyBox ensures the evictable VMs have 100% uptime, while Distr-Grid and Distr-Battery only have 29% and 45% uptime, respectively. This is because SkyBox can timely migrate VMs from the rMDCs that have insufficient renewable power, and keep these VMs operational. But Distr-Grid and Distr-Battery have to suspend these VMs, otherwise, they have to use power grid, resulting in increased operational carbon footprint.

SkyBox does not rely on evictable VMs to gain benefits. With different proportions of evictable VMs (10%-50%), even when the uptime percentage of all evictable VMs keeps at 100%, SkyBox still effectively reduces the carbon footprint, because of the stable renewable power offered in subgraphs.

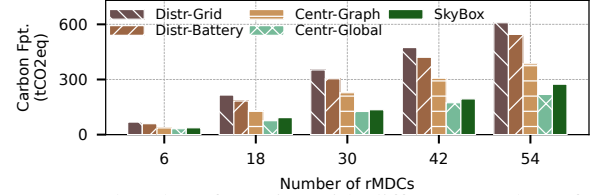


Fig. 13: Total carbon footprint with different number of sites.

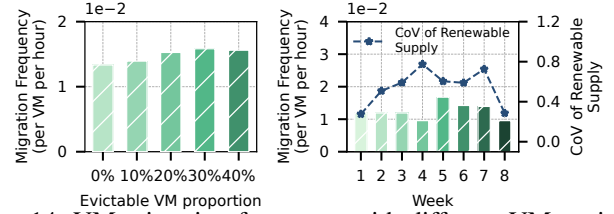


Fig. 14: VM migration frequency with different VM settings.

E. Sensitivity Analysis

Varying the number of rMDCs: We show the scalability of SkyBox by increasing the number of rMDCs from 6 to 54. As shown in Figure 13, the total carbon footprint of SkyBox is close to ideal, and SkyBox consistently outperforms Distr-Grid and Distr-Battery as we increase the number of rMDCs. We also observe that SkyBox has even greater carbon reduction (from 45% to 56%) with more rMDCs. This is because a larger pool of candidate subgraphs (e.g., 20 candidates with 6 sites vs. 24.8K candidates with 54 sites) increases the opportunities for SkyBox to identify more stable subgraphs.

Varying migration frequency: We evaluate SkyBox under different migration frequencies, where the frequency is measured by the number of migration events per VM per hour of runtime. Figure 14 (left) shows that under different evictable VM proportions, SkyBox obtains consistent carbon footprint reduction with low migration frequency (around 0.015). Consider that live migration has low power consumption, only tens of milliseconds of VM downtime, and low impact on application performance [3], [19], [54], SkyBox does not incur much migration overhead. We show that SkyBox delivers constant migration frequency over time (Figure 14, right), under the setting of 0% evictable VMs.

Varying battery capacity: We present the benefit of SkyBox using different battery capacities (from a 15-minute to a 4-hour backup time). As shown in Figure 15, the increased battery capacities help offset more operational carbon footprint for SkyBox. SkyBox without extra battery can bring more benefits than Distr-Battery with a large battery capacity. This is because Distr-Battery has limited opportunity to keep the batteries charged upon insufficient renewable power supply,

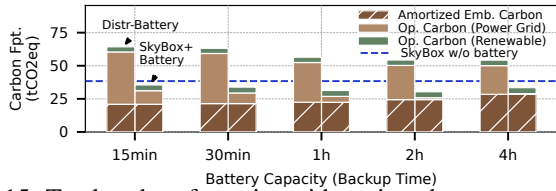


Fig. 15: Total carbon footprint with various battery capacities.

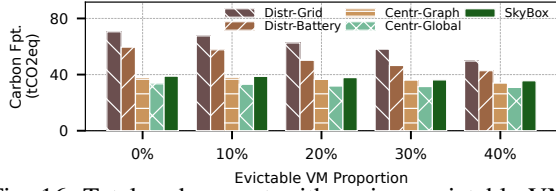


Fig. 16: Total carbon cost with various evictable VMs.

while SkyBox can migrate VMs to another rMDC.

Varying evictable VM proportion: In Figure 16, we change the proportion of the evictable VMs from 0% to 40%. The total carbon footprint decreases for all the placement policies, as evictable VMs offer more flexibility in the VM scheduling. SkyBox consistently outperforms Distr-Grid and Distr-Battery. Even with 0% evictable VMs (i.e., all VMs are regular), SkyBox outperforms Distr-Grid and Distr-Battery, with a reduction of the total carbon footprint of 44% and 35% respectively. SkyBox also incurs only 2% and 14% extra carbon compared to the Centr-Graph and Centr-Global, respectively.

F. Benefit Breakdown of SkyBox

We now evaluate the benefit of each SkyBox component. We compare SkyBox with its variants, each replacing one SkyBox component with a baseline policy (e.g., MIP Model vs. Best-Effort VM allocation). We first show the comparison of the total carbon footprint in Figure 17. By identifying stabler renewable energy farms, SkyBox reduces the total carbon footprint by 53%, compared to the random site selection scheme (SkyBox-NoSI). With subgraph identification, SkyBox groups multiple rMDCs to further achieve stable aggregated power production. It helps SkyBox to reduce 37% carbon footprint compared with the random subgraph identification (SkyBox-NoSG). Furthermore, SkyBox can find a more optimized VM placement and migration plan using our proposed MIP model, leading to a 39% less carbon footprint than the best-effort VM placement policy (SkyBox-BestEffort).

To further evaluate how the MIP model of SkyBox optimizes VM placement and migration, we compare SkyBox against SkyBox-BestEffort. In Figure 18, with the same carbon footprint, SkyBox achieves higher VM uptime for evictable VMs. Their gap is larger with more evictable VMs. This is because the scheduling of a larger set of VMs across rMDCs forms an more complicated decision space, it is harder for the heuristic-based approach (i.e., best-effort) to find optimized VM placement and migration plans.

G. Resilience to Mispredictions

We now demonstrate the robustness of SkyBox in handling the mispredictions of power supply and VM lifetime. In

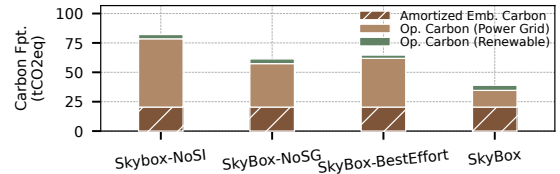


Fig. 17: Benefits of different SkyBox components.

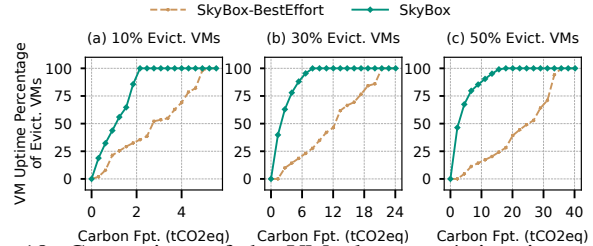


Fig. 18: Comparison of the VM placement/migration policy in SkyBox vs. the best-effort approach.

Figure 19, we vary the maximum misprediction ratios of the renewable power production and the VM lifetime from $-50%$ to $50%$, and present the percentage of increased carbon footprint against SkyBox with accurate predictions.

The mispredictions of power production incur a small increase in the total carbon footprint (0.6%-9.7%). And in practice, power production usually has a low prediction error. For instance, the misprediction ratio of a 3-hour-ahead power production prediction is typically $\pm 20%$ (9% on average, see §II-B), where SkyBox has less than 3.7% carbon footprint overhead. As for VM lifetime mispredictions, their impact is trivial (up to 3%) in SkyBox.

VI. RELATED WORK

Renewable energy for data centers. Using renewable energy to power data centers has been investigated in prior studies [32], [34]–[36], [52], [53], [68], [76]. They benefited the recent development of containerized, mobile, truck, and edge data centers [13], [24], [81] that enable platform operators to move data centers closer to renewable energy farms with low cost. Most recently, a majority of popular cloud providers have been planning to use renewable energy in their data centers [2], [5], [38], [61], and discussed how to build carbon-aware data centers with renewable energy [2]. Our work SkyBox shares the same goal with these prior studies, but proposes a new approach of building modular data centers at scale.

Energy and carbon efficiency of data centers. To improve the energy efficiency of data centers, a variety of computer architecture and systems techniques have been developed [22], [23], [49], [50], [71], [77], [88], including the dynamic voltage and frequency scaling, and the power management in different server components (e.g., CPU cores, caches, and memory). Researchers also developed many power-aware scheduling policies across the entire systems stack [3], [12], [14], [16], [18], [33]–[35], [43], [57], [82], [84], [85], [89], such as workload scheduling and VM placement. Recently, more studies have focused on improving the carbon efficiency [10], [40], [41], [67], [75], [86], [87]. These studies are orthogonal to our

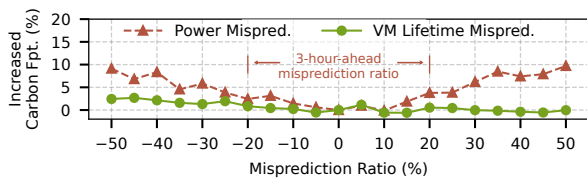


Fig. 19: The impact of different misprediction ratios of power supply and VM lifetime in SkyBox.

work. SkyBox focuses on exploring the efficiency of renewable energy with modular data centers.

Energy-based elasticity and reliability. To provide reliable and elastic computing for cloud services, prior studies proposed power-aware workload migration policies across data centers, depending on the energy cost and availability [7], [17], [55], [56]. And they investigated the use of VM migration [70], [72], [74], replication [21], [51], and checkpointing [63], [64] to manage faults and power outages. Unlike these prior studies, SkyBox develops new algorithms for VM placement and migrations across geo-distributed modular data centers.

VII. CONCLUSION

We present SkyBox, a framework for facilitating the deployment of geo-distributed modular data centers at scale. It tackles the power variability of renewables with the insights derived from the study of real-world power traces. SkyBox presents a set of techniques to assist datacenter vendors to identify the suitable sites for deploying modular data centers, and enable efficient VM placement and migrations.

REFERENCES

- [1] "How much energy do data centers consume?" <https://www.techtarget.com/searchdatacenter/tip/How-much-energy-do-data-centers-consume>, 2022.
- [2] B. Acun, B. Lee, F. Kazhamiaka, K. Maeng, M. Chakkaravarthy, U. Gupta, D. Brooks, and C.-J. Wu, "Carbon explorer: A holistic framework for designing carbon aware datacenters," in *Proceedings of the 28th International Conference on Architectural Support for Programming Languages and Operating Systems (ASPLOS'23)*, Vancouver, Canada, 2023.
- [3] S. Akoush, R. Sohan, A. Rice, A. W. Moore, and A. Hopper, "Free lunch: Exploiting renewable energy for computing," in *13th Workshop on Hot Topics in Operating Systems (HotOS XIII)*. Napa, CA: USENIX Association, May 2011. [Online]. Available: <https://www.usenix.org/conference/hotosxiii/free-lunch-exploiting-renewable-energy-computing>
- [4] Amazon, "Spot Instances," <https://docs.aws.amazon.com/AWSEC2/latest/UserGuide/using-spot-instances.html>, 2020.
- [5] A. AWS, "Why moving to the cloud should be part of your sustainability strategy," <https://aws.amazon.com/blogs/publicsector/why-moving-cloud-part-of-sustainability-strategy/>, 2021.
- [6] Azure, "Microsoft azure traces," <https://github.com/Azure/AzurePublicDataset/tree/master>, 2022.
- [7] S. Bahrami, V. W. Wong, and J. Huang, "Data center demand response in deregulated electricity markets," *IEEE Transactions on Smart Grid*, vol. 10, no. 3, pp. 2820–2832, 2018.
- [8] H. Barbalho, P. Kovalski, B. Li, L. Marshall, M. Molinaro, A. Pan, E. Cortez, M. Leao, H. Patwari, Z. Tang *et al.*, "Virtual machine allocation with lifetime predictions," *Proceedings of Machine Learning and Systems*, vol. 5, 2023.
- [9] L. A. Barroso, U. Hölzle, and P. Ranganathan, *The datacenter as a computer: Designing warehouse-scale machines*. Springer Nature, 2019.
- [10] N. Bashir, T. Guo, M. Hajiesmaili, D. Irwin, P. Shenoy, R. Sitaraman, A. Souza, and A. Wierman, "Enabling sustainable clouds: The case for virtualizing the energy system," in *Proceedings of the ACM Symposium on Cloud Computing*, 2021, pp. 350–358.
- [11] J. L. Berral, . Goiri, T. D. Nguyen, R. Gavaldà, J. Torres, and R. Bianchini, "Building green cloud services at low cost," in *Proceedings of the 2014 IEEE 34th International Conference on Distributed Computing Systems (ICDCS'14)*, 2014.
- [12] J. L. Berral, Í. Goiri, R. Nou, F. Julià, J. Guitart, R. Gavaldà, and J. Torres, "Towards energy-aware scheduling in data centers using machine learning," in *Proceedings of the 1st International Conference on Energy-Efficient Computing and Networking*, 2010, pp. 215–224.
- [13] F. Board, "Truck data center: The core component of the networked truck," <https://www.fleetboard.info/digital-solutions/hardware/truck-data-center/#/>, 2022.
- [14] G. C. Buttazzo, G. Lipari, M. Caccamo, and L. Abeni, "Elastic scheduling for flexible workload management," *IEEE Transactions on Computers*, vol. 51, no. 3, pp. 289–302, 2002.
- [15] U. o. M. Center for Sustainable Systems, "US Grid Energy Storage Factsheet," <http://css.umich.edu/factsheets/us-grid-energy-storage-factsheet>, 2020.
- [16] A. Chatzipapas, D. Peditidakis, C. Rotsos, V. Mancuso, J. Crowcroft, and A. Moore, "Challenge: Resolving data center power bill disputes: The energy-performance trade-offs of consolidation," in *Proceedings of the 2015 ACM Sixth International Conference on Future Energy Systems*, 2015, pp. 89–94.
- [17] H. Chen, M. C. Caramanis, and A. K. Coskun, "The data center as a grid load stabilizer," in *2014 19th Asia and South Pacific Design Automation Conference (ASP-DAC)*. IEEE, 2014, pp. 105–112.
- [18] A. A. Chien, R. Wolski, and F. Yang, "The zero-carbon cloud: High-value, dispatchable demand for renewable power generators," *The Electricity Journal*, vol. 28, no. 8, pp. 110–118, 2015. [Online]. Available: <https://www.sciencedirect.com/science/article/pii/S1040619015001931>
- [19] C. Clark, K. Fraser, S. Hand, J. G. Hansen, E. Jul, C. Limpach, I. Pratt, and A. Warfield, "Live migration of virtual machines," in *Proceedings of the 2nd conference on Symposium on Networked Systems Design & Implementation-Volume 2*, 2005, pp. 273–286.
- [20] E. Cortez, A. Bonde, A. Muzio, M. Russinovich, M. Fontoura, and R. Bianchini, "Resource central: Understanding and predicting workloads for improved resource management in large cloud platforms," in *Proceedings of the 26th Symposium on Operating Systems Principles (SOSP '17)*, 2017, pp. 153–167.
- [21] B. Cully, G. Lefebvre, D. Meyer, M. Feeley, N. Hutchinson, and A. Warfield, "Remus: High availability via asynchronous virtual machine replication," in *Proceedings of the 5th USENIX symposium on networked systems design and implementation*. San Francisco, 2008, pp. 161–174.
- [22] H. David, C. Fallin, E. Gorbatov, U. R. Hanebutte, and O. Mutlu, "Memory power management via dynamic voltage/frequency scaling," in *Proceedings of the 8th ACM international conference on Autonomic computing*, 2011, pp. 31–40.
- [23] H. David, E. Gorbatov, U. R. Hanebutte, R. Khanna, and C. Le, "Rapl: Memory power estimation and capping," in *2010 ACM/IEEE International Symposium on Low-Power Electronics and Design (ISLPED)*. IEEE, 2010, pp. 189–194.
- [24] Delta, "All-in-one containerized data center solutions," <https://www.deltapowersolutions.com/en/mcis/data-center-solutions-containerized-datacenter.php>, 2022.
- [25] ELIA, "Solar and Wind Generation," <https://www.elia.be/en/grid-data/power-generation>, 2021.
- [26] E. Emilsson and L. Dahllöf, "Lithium-ion vehicle battery production-status 2019 on energy use, co2 emissions, use of metals, products environmental footprint, and recycling," 2019.
- [27] U. Energy Information Administration, "Electricity explained: Electricity generation, capacity, and sales in the united states," <https://www.eia.gov/energyexplained/electricity/electricity-in-the-us-generation-capacity-and-sales.php>, 2020.
- [28] H. P. Enterprise, "Hpe product carbon footprint hpe proliant dl580 gen10 server data sheet," https://www.hpe.com/psnow/doc/a50005153enw.pdf?jumpid=in_pdfviewer-psnow, 2023.
- [29] Facebook, "Facebook's u.s. renewable energy impact study," <https://www.rti.org/publication/facebook-us-renewable-energy/fulltext.pdf>, 2021.

- [30] R. L. Fares and C. W. King, "Trends in transmission, distribution, and administration costs for us investor-owned electric utilities," *Energy Policy*, vol. 105, pp. 354–362, 2017.
- [31] FrontlineSolvers, "Mixed-integer programming (mip) problems," <https://www.solver.com/integer-constraint-programming>, 2022.
- [32] I. n. Goiri, W. Katsak, K. Le, T. D. Nguyen, and R. Bianchini, "Parasol and greenswitch: Managing datacenters powered by renewable energy," in *Proceedings of the Eighteenth International Conference on Architectural Support for Programming Languages and Operating Systems (ASPLOS'13)*, Houston, Texas, USA, 2013.
- [33] I. n. Goiri, W. Katsak, K. Le, T. D. Nguyen, and R. Bianchini, "Parasol and greenswitch: Managing datacenters powered by renewable energy," vol. 41, no. 1, p. 5164, 2013.
- [34] Í. Goiri, K. Le, M. E. Haque, R. Beauchea, T. D. Nguyen, J. Guitart, J. Torres, and R. Bianchini, "Greenslot: scheduling energy consumption in green datacenters," in *Proceedings of 2011 International Conference for High Performance Computing, Networking, Storage and Analysis*, 2011, pp. 1–11.
- [35] Í. Goiri, K. Le, T. D. Nguyen, J. Guitart, J. Torres, and R. Bianchini, "Greenhadoop: leveraging green energy in data-processing frameworks," in *Proceedings of the 7th ACM european conference on Computer Systems*, 2012, pp. 57–70.
- [36] . Goiri, W. Katsak, K. Le, T. D. Nguyen, and R. Bianchini, "Designing and managing data centers powered by renewable energy," *IEEE Micro*, vol. 34, no. 3, 2014.
- [37] I. Gonzalez Aparicio, T. Huld, F. Careri, F. Monforti, and A. Zucker, "EMHIRES dataset Part II: Solar power generation," *European Meteorological derived High resolution RES generation time series for present and future scenarios. Part II: PV generation using the PVGIS model*, 2017.
- [38] Google, "Our third decade of climate action: Realizing a carbon-free future," <https://blog.google/outreach-initiatives/sustainability/our-third-decade-climate-action-realizing-carbon-free-future/>, 2020.
- [39] Google, "Cloud sustainability," <https://cloud.google.com/sustainability>, 2021.
- [40] U. Gupta, M. Elgamal, G. Hills, G.-Y. Wei, H.-H. S. Lee, D. Brooks, and C.-J. Wu, "Act: Designing sustainable computer systems with an architectural carbon modeling tool," in *Proceedings of the 49th Annual International Symposium on Computer Architecture*, 2022, pp. 784–799.
- [41] U. Gupta, Y. G. Kim, S. Lee, J. Tse, H.-H. S. Lee, G.-Y. Wei, D. Brooks, and C.-J. Wu, "Chasing carbon: The elusive environmental footprint of computing," in *2021 IEEE International Symposium on High-Performance Computer Architecture (HPCA)*. IEEE, 2021, pp. 854–867.
- [42] L. Gurobi Optimization, "Gurobi optimizer reference manual," 2018.
- [43] O. Hadary, L. Marshall, I. Menache, A. Pan, E. E. Greeff, D. Dion, S. Dorminey, S. Joshi, Y. Chen, M. Russinovich *et al.*, "Protean: {VM} allocation service at scale," in *14th USENIX Symposium on Operating Systems Design and Implementation (OSDI '20)*, 2020, pp. 845–861.
- [44] J. Hamilton, "Architecture for modular data centers," *arXiv preprint cs/0612110*, 2006.
- [45] IBM, "Prefabricated modular data center add data center capacity where and when you need it," <https://www.ibm.com/downloads/cas/YXKNDQAO>, 2014.
- [46] G. A. Iratxe, A. Zucker, F. Careri, F. Monforti, T. Huld, and J. Badger, "EMHIRES dataset Part I: Wind power generation," 2016.
- [47] JustEnergy, "Renewable Energy vs. Traditional Energy: The Real Cost," <https://justenergy.com/blog/renewable-energy-vs-traditional-energy-the-real-cost/>, 2021.
- [48] A. Kansal, F. Zhao, J. Liu, N. Kothari, and A. A. Bhattacharya, "Virtual machine power metering and provisioning," in *Proceedings of the 1st ACM symposium on Cloud computing*, 2010, pp. 39–50.
- [49] V. Kontorinis, L. E. Zhang, B. Aksanli, J. Sampson, H. Homayoun, E. Pettis, D. M. Tullsen, and T. S. Rosing, "Managing distributed ups energy for effective power capping in data centers," in *2012 39th Annual International Symposium on Computer Architecture (ISCA)*. IEEE, 2012, pp. 488–499.
- [50] A. Kumbhare, R. Azimi, I. Manousakis, A. Bonde, F. Frujeri, N. Mahalingam, P. Misra, S. A. Javadi, B. Schroeder, M. Fontoura *et al.*, "Prediction-based power oversubscription in cloud platforms," *arXiv preprint arXiv:2010.15388*, 2020.
- [51] H. A. Lagar-Cavilla, J. A. Whitney, A. M. Scannell, P. Patchin, S. M. Rumble, E. De Lara, M. Brudno, and M. Satyanarayanan, "Snowflock: rapid virtual machine cloning for cloud computing," in *Proceedings of the 4th ACM European conference on Computer systems*, 2009, pp. 1–12.
- [52] C. Li, Y. Hu, R. Zhou, M. Liu, L. Liu, J. Yuan, and T. Li, "Enabling datacenter servers to scale out economically and sustainably," in *Proceedings of the 46th Annual IEEE/ACM International Symposium on Microarchitecture (MICRO'13)*, Davis, California, 2013.
- [53] C. Li, A. Qouneh, and T. Li, "Iswitch: Coordinating and optimizing renewable energy powered server clusters," in *Proceedings of the 39th Annual International Symposium on Computer Architecture (ISCA'12)*, Portland, Oregon, 2012.
- [54] H. Liu, C.-Z. Xu, H. Jin, J. Gong, and X. Liao, "Performance and energy modeling for live migration of virtual machines," in *Proceedings of the 20th International Symposium on High Performance Distributed Computing*, ser. HPDC '11. New York, NY, USA: Association for Computing Machinery, 2011.
- [55] Z. Liu, I. Liu, S. Low, and A. Wierman, "Pricing data center demand response," *ACM SIGMETRICS Performance Evaluation Review*, vol. 42, no. 1, pp. 111–123, 2014.
- [56] Z. Liu, A. Wierman, Y. Chen, B. Razon, and N. Chen, "Data center demand response: Avoiding the coincident peak via workload shifting and local generation," *Performance Evaluation*, vol. 70, no. 10, pp. 770–791, 2013.
- [57] K. Mahajan, M. Chowdhury, A. Akella, and S. Chawla, "Dynamic query {Re-Planning} using {QOOP}," in *13th USENIX Symposium on Operating Systems Design and Implementation (OSDI 18)*, 2018, pp. 253–267.
- [58] S. McCluer and J.-F. Christin, "Comparing data center batteries, flywheels, and ultracapacitors," *White paper*, vol. 65, p. 202, 2008.
- [59] Microsoft, "Introducing the microsoft azure modular datacenter," <https://azure.microsoft.com/en-us/blog/introducing-the-microsoft-azure-modular-datacenter/>, 2020.
- [60] Microsoft, "Use Azure Spot Virtual Machines," <https://docs.microsoft.com/en-us/azure/virtual-machines/spot-vms>, 2020.
- [61] Microsoft, "Azure sustainability," <https://azure.microsoft.com/en-in/global-infrastructure/sustainability/>, 2021.
- [62] Microsoft, "Microsoft announces intent to build a new datacenter region in finland, accelerating sustainable digital transformation and enabling large scale carbon-free district heating," <https://news.microsoft.com/europe/2022/03/17/microsoft-announces-intent-to-build-a-new-datacenter-region-in-finland-accelerating-sustainable-digital-transformation-and-enabling-large-scale-carbon-free-district-heating/>, 2022.
- [63] J. Mohan, A. Phanishayee, and V. Chidambaram, "Checkfreq: Frequent, fine-grained DNN checkpointing," in *19th USENIX Conference on File and Storage Technologies (FAST '21)*, 2021, pp. 203–216.
- [64] A. Moody, G. Bronevetsky, K. Mohror, and B. R. De Supinski, "Design, modeling, and evaluation of a scalable multi-level checkpointing system," in *SC'10: Proceedings of the 2010 ACM/IEEE International Conference for High Performance Computing, Networking, Storage and Analysis*. IEEE, 2010, pp. 1–11.
- [65] NREL, "Commercial battery storage," https://atb.nrel.gov/electricity/2022/commercial_battery_storage, 2022.
- [66] T. S. project, "Lean ICT – TOWARDS DIGITAL SOBRIETY," Tech. Rep., 03 2019.
- [67] A. Radovanović, R. Koningstein, I. Schneider, B. Chen, A. Duarte, B. Roy, D. Xiao, M. Haridasan, P. Hung, N. Care *et al.*, "Carbon-aware computing for datacenters," *IEEE Transactions on Power Systems*, vol. 38, no. 2, pp. 1270–1280, 2022.
- [68] C. Ren, D. Wang, B. Urgaonkar, and A. Sivasubramaniam, "Carbon-aware energy capacity planning for datacenters," in *2012 IEEE 20th International Symposium on Modeling, Analysis and Simulation of Computer and Telecommunication Systems*. IEEE, 2012, pp. 391–400.
- [69] B. X. Rodriguez, "Embodied carbon of heating, ventilation, air conditioning and refrigerants (hvac+ r) systems," Ph.D. dissertation, 2019.
- [70] A. Ruprecht, D. Jones, D. Shirayev, G. Harmon, M. Spivak, M. Krebs, M. Baker-Harvey, and T. Sanderson, "Vm live migration at scale," *ACM SIGPLAN Notices*, vol. 53, no. 3, pp. 45–56, 2018.
- [71] R. Schwartz, J. Dodge, N. A. Smith, and O. Etzioni, "Green ai," *Commun. ACM*, vol. 63, no. 12, p. 5463, Nov. 2020. [Online]. Available: <https://doi.org/10.1145/3381831>
- [72] P. Sharma, S. Lee, T. Guo, D. Irwin, and P. Shenoy, "Spotcheck: Designing a derivative iaas cloud on the spot market," in *Proceedings of the Tenth European Conference on Computer Systems*, 2015, pp. 1–15.

- [73] J. Shuja, A. Gani, S. Shamshirband, R. W. Ahmad, and K. Bilal, "Sustainable cloud data centers: a survey of enabling techniques and technologies," *Renewable and Sustainable Energy Reviews*, vol. 62, pp. 195–214, 2016.
- [74] R. Singh, D. Irwin, P. Shenoy, and K. K. Ramakrishnan, "Yank: Enabling green data centers to pull the plug," in *10th USENIX Symposium on Networked Systems Design and Implementation (NSDI 13)*, 2013, pp. 143–155.
- [75] A. Souza, N. Bashir, J. Murillo, W. Hanafy, Q. Liang, D. Irwin, and P. Shenoy, "Ecovisor: A virtual energy system for carbon-efficient applications," in *Proceedings of the 28th ACM International Conference on Architectural Support for Programming Languages and Operating Systems, Volume 2*, 2023, pp. 252–265.
- [76] C. Stewart and K. Shen, "Some joules are more precious than others: Managing renewable energy in the datacenter," in *Proceedings of the workshop on power aware computing and systems*. IEEE, 2009, pp. 15–19.
- [77] C. Subramanian, A. Vasan, and A. Sivasubramaniam, "Reducing data center power with server consolidation: Approximation and evaluation," in *2010 International Conference on High Performance Computing*. IEEE, 2010, pp. 1–10.
- [78] H. Technologies, "Huawei fusionmodule2000 smart modular data center solution," <https://e.huawei.com/en/material/networkenergy/dcenergy/450821c30cb5499eb5e2fe39f09942b9>, 2021.
- [79] The Climate Pledge, "See which companies and organizations have committed to net zero carbon by 2040," <https://www.theclimatepledge.com/us/en/Signatories>, 2021.
- [80] C. C. Thompson, P. K. Oikonomou, A. H. Etemadi, and V. J. Sorger, "Optimization of data center battery storage investments for microgrid cost savings, emissions reduction, and reliability enhancement," *IEEE Transactions on Industry Applications*, vol. 52, no. 3, pp. 2053–2060, 2016.
- [81] K. Trailer, "Mobile data center," <https://www.kytrailer.com/Specialty-Trailers/Category/1/Commercial/Type/6/Mobile-Data-Center>, 2022.
- [82] A. Verma, L. Pedrosa, M. R. Korupolu, D. Oppenheimer, E. Tune, and J. Wilkes, "Large-scale cluster management at Google with Borg," in *Proceedings of the European Conference on Computer Systems (EuroSys)*, Bordeaux, France, 2015.
- [83] K. V. Vishwanath, A. Greenberg, and D. A. Reed, "Modular data centers: how to design them?" in *Proceedings of the 1st ACM workshop on Large-Scale system and application performance*, 2009, pp. 3–10.
- [84] G. Von Laszewski, L. Wang, A. J. Younge, and X. He, "Power-aware scheduling of virtual machines in dvfs-enabled clusters," in *2009 IEEE International Conference on Cluster Computing and Workshops*. IEEE, 2009, pp. 1–10.
- [85] C. Wang, B. Urgaonkar, Q. Wang, G. Kesidis, and A. Sivasubramaniam, "Data center power cost optimization via workload modulation," in *2013 IEEE/ACM 6th International Conference on Utility and Cloud Computing*. IEEE, 2013, pp. 260–263.
- [86] J. Wang, U. Gupta, and A. Sriraman, "Peeling back the carbon curtain: Carbon optimization challenges in cloud computing," in *Proceedings of the 2nd Workshop on Sustainable Computer Systems*, 2023, pp. 1–7.
- [87] P. Wiesner, I. Behnke, D. Scheinert, K. Gontarska, and L. Thamsen, "Let's wait awhile: How temporal workload shifting can reduce carbon emissions in the cloud," in *Proceedings of the 22nd International Middleware Conference*, 2021, pp. 260–272.
- [88] C.-M. Wu, R.-S. Chang, and H.-Y. Chan, "A green energy-efficient scheduling algorithm using the dvfs technique for cloud datacenters," *Future Generation Computer Systems*, vol. 37, pp. 141–147, 2014.
- [89] C. Zhang, A. Kumbhare, I. Manousakis, D. Zhang, P. Misra, R. Assis, K. Woolcock, N. Mahalingam, B. Warriar, D. Gauthier, L. Kunnath, S. Solomon, O. Morales, M. Fontoura, and R. Bianchini, "Flex: High-availability datacenters with zero reserved power," in *Proceedings of the International Symposium on Computer Architecture (ISCA'21)*, June 2021.