

# *The European Union*

## EDICT OF GOVERNMENT

In order to promote public education and public safety, equal justice for all, a better informed citizenry, the rule of law, world trade and world peace, this legal document is hereby made available on a noncommercial basis, as it is the right of all humans to know and speak the laws that govern them.

EN 1991-1-2 (2002) (English): Eurocode 1: Actions on structures - Part 1-2: General actions - Actions on structures exposed to fire [Authority: The European Union Per Regulation 305/2011, Directive 98/34/EC, Directive 2004/18/EC]



BLANK PAGE



English version

**Eurocode 1: Actions on structures - Part 1-2: General actions -  
Actions on structures exposed to fire**

Eurocode 1: Actions sur les structures au feu - Partie 1-2:  
Actions générales - Actions sur les structures exposées

Eurocode 1 - Einwirkungen auf Tragwerke - Teil 1-2:  
Allgemeine Einwirkungen - Brandeinwirkungen auf  
Tragwerke

This European Standard was approved by CEN on 1 September 2002.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the Management Centre or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the Management Centre has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Czech Republic, Denmark, Finland, France, Germany, Greece, Iceland, Ireland, Italy, Luxembourg, Malta, Netherlands, Norway, Portugal, Spain, Sweden, Switzerland and United Kingdom.



EUROPEAN COMMITTEE FOR STANDARDIZATION  
COMITÉ EUROPÉEN DE NORMALISATION  
EUROPÄISCHES KOMITEE FÜR NORMUNG

Management Centre: rue de Stassart, 36 B-1050 Brussels

## Contents

page

<b>Foreword</b>	<b>4</b>
<b>Section 1 General</b>	<b>10</b>
1.1 Scope	10
1.2 Normative references	10
1.3 Assumptions	11
1.4 Distinction between Principles and Application Rules	11
1.5 Terms and definitions	11
1.5.1 Common terms used in Eurocode Fire parts	11
1.5.2 Special terms relating to design in general	13
1.5.3 Terms relating to thermal actions	13
1.5.4 Terms relating to heat transfer analysis	15
1.6 Symbols	15
<b>Section 2 Structural Fire design procedure</b>	<b>21</b>
2.1 General	21
2.2 Design fire scenario	21
2.3 Design fire	21
2.4 Temperature Analysis	21
2.5 Mechanical Analysis	22
<b>Section 3 Thermal actions for temperature analysis</b>	<b>23</b>
3.1 General rules	23
3.2 Nominal temperature-time curves	24
3.2.1 Standard temperature-time curve	24
3.2.2 External fire curve	24
3.2.3 Hydrocarbon curve	25
3.3 Natural fire models	25
3.3.1 Simplified fire models	25
3.3.1.1 General	25
3.3.1.2 Compartment fires	25
3.3.1.3 Localised fires	26
3.3.2 Advanced fire models	26
<b>Section 4 Mechanical actions for structural analysis</b>	<b>27</b>
4.1 General	27
4.2 Simultaneity of actions	27
4.2.1 Actions from normal temperature design	27
4.2.2 Additional actions	28
4.3 Combination rules for actions	28
4.3.1 General rule	28
4.3.2 Simplified rules	28
4.3.3 Load level	29
<b>Annex A (informative) Parametric temperature-time curves</b>	<b>30</b>
<b>Annex B (informative) Thermal actions for external members - Simplified calculation method</b>	<b>33</b>
B.1 Scope	33
B.2 Conditions of use	33

B.3	Effects of wind .....	34
B.3.1	Mode of ventilation.....	34
B.3.2	Flame deflection by wind .....	34
B.4	Characteristics of fire and flames.....	35
B.4.1	No forced draught.....	35
B.4.2	Forced draught .....	37
B.5	Overall configuration factors.....	39
<b>Annex C (informative) Localised fires.....</b>		<b>41</b>
<b>Annex D (informative) Advanced fire models.....</b>		<b>44</b>
D.1	One-zone models .....	44
D.2	Two-zone models .....	45
D.3	Computational fluid dynamic models.....	45
<b>Annex E (informative) Fire load densities .....</b>		<b>46</b>
E.1	General.....	46
E.2	Determination of fire load densities .....	47
E.2.1	General.....	47
E.2.2	Definitions.....	47
E.2.3	Protected fire loads.....	48
E.2.4	Net calorific values .....	48
E.2.5	Fire load classification of occupancies .....	50
E.2.6	Individual assessment of fire load densities .....	50
E.3	Combustion behaviour .....	50
E.4	Rate of heat release $Q$ .....	51
<b>Annex F (informative) Equivalent time of fire exposure .....</b>		<b>53</b>
<b>Annex G (informative) Configuration factor .....</b>		<b>55</b>
G.1	General.....	55
G.2	Shadow effects.....	56
G.3	External members .....	56
<b>Bibliography .....</b>		<b>59</b>

## **Foreword**

This document (EN 1991-1-2:2002) has been prepared by Technical Committee CEN/TC 250 "Structural Eurocodes", the secretariat of which is held by BSI.

CEN/TC250/SC1 is responsible for Eurocode 1.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by May 2003, and conflicting national standards shall be withdrawn at the latest by December 2009.

This document supersedes ENV 1991-2-2:1995.

Annexes A, B, C, D, E, F and G are informative.

According to the CEN/CENELEC Internal Regulations, the national standards organizations of the following countries are bound to implement this European Standard: Austria, Belgium, Czech Republic, Denmark, Finland, France, Germany, Greece, Iceland, Ireland, Italy, Luxembourg, Malta, Netherlands, Norway, Portugal, Spain, Sweden, Switzerland and the United Kingdom.

## **Background of the Eurocode programme**

In 1975, the Commission of the European Community decided on an action programme in the field of construction, based on article 95 of the Treaty. The objective of the programme was the elimination of technical obstacles to trade and the harmonisation of technical specifications.

Within this action programme, the Commission took the initiative to establish a set of harmonised technical rules for the design of construction works which, in a first stage, would serve as an alternative to the national rules in force in the Member States and, ultimately, would replace them.

For fifteen years, the Commission, with the help of a Steering Committee with Representatives of Member States, conducted the development of the Eurocodes programme, which led to the first generation of European codes in the 1980's.

In 1989, the Commission and the Member States of the EU and EFTA decided, on the basis of an agreement<sup>1</sup> between the Commission and CEN, to transfer the preparation and the publication of the Eurocodes to CEN through a series of Mandates, in order to provide them with a future status of European Standard (EN). This links de facto the Eurocodes with the provisions of all the Council's Directives and/or Commission's Decisions dealing with European Standards (e.g. the Council Directive 89/106/EEC on construction products - CPD - and Council Directives 93/37/EEC, 92/50/EEC and 89/440/EEC on public works and services and equivalent EFTA Directives initiated in pursuit of setting up the internal market).

The Structural Eurocode programme comprises the following standards generally consisting of a number of Parts:

EN 1990, Eurocode: Basis of structural design.

EN 1991, Eurocode 1: Actions on structures.

prEN 1992, Eurocode 2: Design of concrete structures.

prEN 1993, Eurocode 3: Design of steel structures.

---

<sup>1</sup> Agreement between the Commission of the European Communities and the European Committee for Standardisation (CEN) concerning the work on EUROCODES for the design of building and civil engineering works (BC/CEN/03/89).

prEN 1994, Eurocode 4: Design of composite steel and concrete structures.

prEN 1995, Eurocode 5: Design of timber structures.

prEN 1996, Eurocode 6: Design of masonry structures.

prEN 1997, Eurocode 7: Geotechnical design.

prEN 1998, Eurocode 8: Design of structures for earthquake resistance.

prEN 1999, Eurocode 9: Design of aluminium structures.

Eurocode standards recognise the responsibility of regulatory authorities in each Member State and have safeguarded their right to determine values related to regulatory safety matters at national level where these continue to vary from State to State.

### **Status and field of application of Eurocodes**

The Member States of the EU and EFTA recognise that EUROCODES serve as reference documents for the following purposes:

- as a means to prove compliance of building and civil engineering works with the essential requirements of Council Directive 89/106/EEC, particularly Essential Requirement N°1 - Mechanical resistance and stability - and Essential Requirement N°2 - Safety in case of fire;
- as a basis for specifying contracts for construction works and related engineering services;
- as a framework for drawing up harmonised technical specifications for construction products (ENs and ETAs).

The Eurocodes, as far as they concern the construction works themselves, have a direct relationship with the Interpretative Documents<sup>2</sup> referred to in Article 12 of the CPD, although they are of a different nature from harmonised product standards<sup>3</sup>. Therefore, technical aspects arising from the Eurocodes work need to be adequately considered by CEN Technical Committees and/or EOTA Working Groups working on product standards with a view to achieving full compatibility of these technical specifications with the Eurocodes.

The Eurocode standards provide common structural design rules for everyday use for the design of whole structures and component products of both a traditional and an innovative nature. Unusual forms of construction or design conditions are not specifically covered and additional expert consideration will be required by the designer in such cases.

---

<sup>2</sup> According to Art. 3.3 of the CPD, the essential requirements (ERs) shall be given concrete form in interpretative documents for the creation of the necessary links between the essential requirements and the mandates for harmonised ENs and ETAGs/ETAs.

<sup>3</sup> According to Art. 12 of the CPD the interpretative documents shall:

- a) give concrete form to the essential requirements by harmonising the terminology and the technical bases and indicating classes or levels for each requirement where necessary;
- b) indicate methods of correlating these classes or levels of requirement with the technical specifications, e.g. methods of calculation and of proof, technical rules for project design, etc.;
- c) serve as a reference for the establishment of harmonised standards and guidelines for European technical approvals.

The Eurocodes, de facto, play a similar role in the field of the ER 1 and a part of ER 2.

## **National standards implementing Eurocodes**

The national standards implementing Eurocodes will comprise the full text of the Eurocode (including any annexes), as published by CEN, which may be preceded by a national title page and national foreword, and may be followed by a national annex.

The national annex may only contain information on those parameters which are left open in the Eurocode for national choice, known as Nationally Determined Parameters, to be used for the design of buildings and civil engineering works to be constructed in the country concerned, i.e.:

- values and/or classes where alternatives are given in the Eurocode;
- values to be used where a symbol only is given in the Eurocode;
- country specific data (geographical, climatic, etc), e.g. snow map;
- the procedure to be used where alternative procedures are given in the Eurocode.

It may also contain:

- decisions on the application of informative annexes and
- references to non-contradictory complementary information to assist the user to apply the Eurocode.

## **Links between Eurocodes and harmonised technical specifications (ENs and ETAs) for products**

There is a need for consistency between the harmonised technical specifications for construction products and the technical rules for works<sup>4</sup>. Furthermore, all the information accompanying the CE Marking of the construction products which refer to Eurocodes shall clearly mention which Nationally Determined Parameters have been taken into account.

## **Additional information specific to EN 1991-1-2**

EN 1991-1-2 describes the thermal and mechanical actions for the structural design of buildings exposed to fire, including the following aspects:

### *Safety requirements*

EN 1991-1-2 is intended for clients (e.g. for the formulation of their specific requirements), designers, contractors and relevant authorities.

The general objectives of fire protection are to limit risks with respect to the individual and society, neighbouring property, and where required, environment or directly exposed property, in the case of fire.

Construction Products Directive 89/106/EEC gives the following essential requirement for the limitation of fire risks:

---

<sup>4</sup> See Art.3.3 and Art.12 of the CPD, as well as 4.2, 4.3.1, 4.3.2 and 5.2 of ID N°1.



"The construction works must be designed and built in such a way, that in the event of an outbreak of fire

- the load bearing resistance of the construction can be assumed for a specified period of time,
- the generation and spread of fire and smoke within the works are limited,
- the spread of fire to neighbouring construction works is limited,
- the occupants can leave the works or can be rescued by other means,
- the safety of rescue teams is taken into consideration".

According to the Interpretative Document N°2 "Safety in Case of Fire"<sup>5</sup> the essential requirement may be observed by following various possibilities for fire safety strategies prevailing in the Member States like conventional fire scenarios (nominal fires) or "natural" (parametric) fire scenarios, including passive and/or active fire protection measures.

The fire parts of Structural Eurocodes deal with specific aspects of passive fire protection in terms of designing structures and parts thereof for adequate load bearing resistance and for limiting fire spread as relevant.

Required functions and levels of performance can be specified either in terms of nominal (standard) fire resistance rating, generally given in national fire regulations or, where allowed by national fire regulations, by referring to fire safety engineering for assessing passive and active measures.

Supplementary requirements concerning, for example:

- the possible installation and maintenance of sprinkler systems;
- conditions on occupancy of building or fire compartment;
- the use of approved insulation and coating materials, including their maintenance

are not given in this document, because they are subject to specification by the competent authority.

Numerical values for partial factors and other reliability elements are given as recommended values that provide an acceptable level of reliability. They have been selected assuming that an appropriate level of workmanship and of quality management applies.

### *Design procedures*

A full analytical procedure for structural fire design would take into account the behaviour of the structural system at elevated temperatures, the potential heat exposure and the beneficial effects of active and passive fire protection systems, together with the uncertainties associated with these three features and the importance of the structure (consequences of failure).

---

<sup>5</sup> See 2.2, 3.2(4) and 4.2.3.3 of ID N°2.

At the present time it is possible to undertake a procedure for determining adequate performance which incorporates some, if not all, of these parameters and to demonstrate that the structure, or its components, will give adequate performance in a real building fire. However where the procedure is based on a nominal (standard) fire, the classification system, which calls for specific periods of fire resistance, takes into account (though not explicitly) the features and uncertainties described above.

Application of this Part 1-2 is illustrated below. The prescriptive approach and the performance-based approach are identified. The prescriptive approach uses nominal fires to generate thermal actions. The performance-based approach, using fire safety engineering, refers to thermal actions based on physical and chemical parameters.

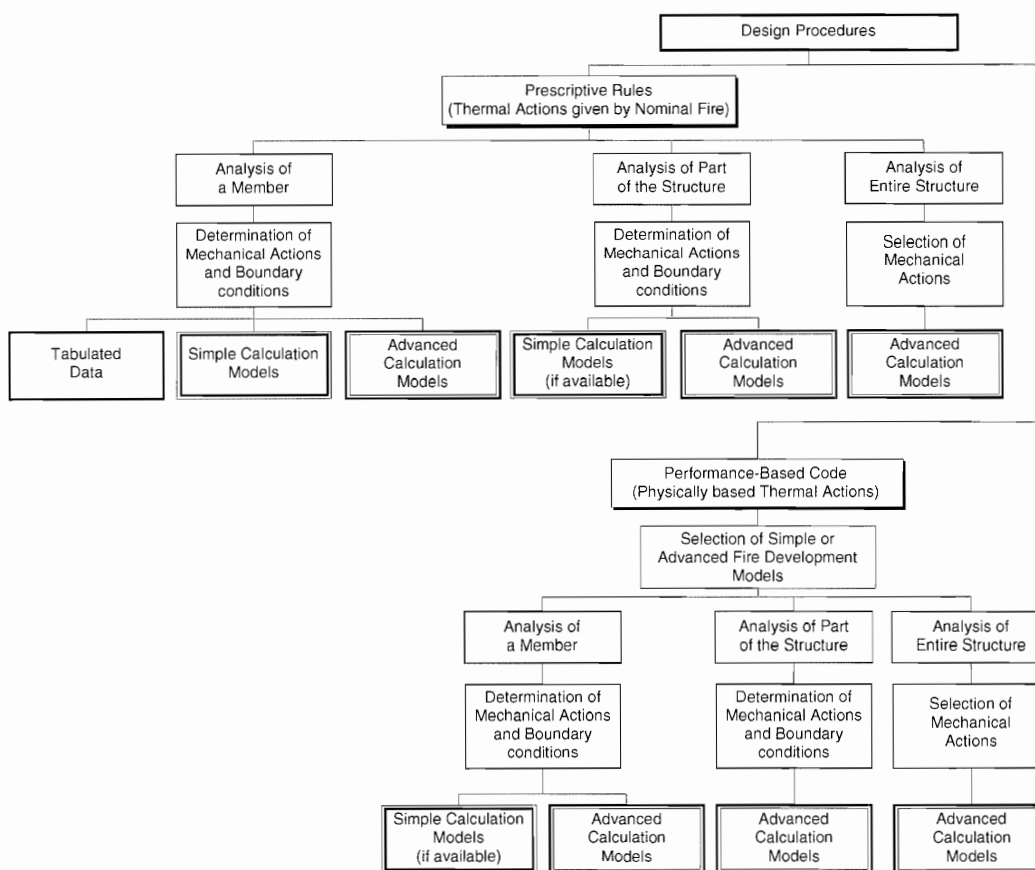


Figure 1 — Alternative design procedures

*Design aids*

It is expected, that design aids based on the calculation models given in EN 1991-1-2 will be prepared by interested external organizations.

The main text of EN 1991-1-2 includes most of the principal concepts and rules necessary for describing thermal and mechanical actions on structures.

### **National annex for EN 1991-1-2**

This standard gives alternative procedures, values and recommendations for classes with notes indicating where national choices have to be made. Therefore the national standard implementing EN 1991-1-2 should have a national annex containing all Nationally Determined Parameters to be used for the design of buildings and civil engineering works to be constructed in the relevant country.

National choice is allowed in EN 1991-1-2 through:

- 2.4(4)
- 3.1(10)
- 3.3.1.1(1)
- 3.3.1.2(1)
- 3.3.1.2(2)
- 3.3.1.3(1)
- 3.3.2(1)
- 3.3.2(2)
- 4.2.2(2)
- 4.3.1(2)

## Section 1 General

### 1.1 Scope

(1) The methods given in this Part 1-2 of EN 1991 are applicable to buildings, with a fire load related to the building and its occupancy.

(2) This Part 1-2 of EN 1991 deals with thermal and mechanical actions on structures exposed to fire. It is intended to be used in conjunction with the fire design Parts of prEN 1992 to prEN 1996 and prEN 1999 which give rules for designing structures for fire resistance.

(3) This Part 1-2 of EN 1991 contains thermal actions related to nominal and physically based thermal actions. More data and models for physically based thermal actions are given in annexes.

(4) This Part 1-2 of EN 1991 gives general principles and application rules in connection to thermal and mechanical actions to be used in conjunction with EN 1990, EN 1991-1-1, EN 1991-1-3 and EN 1991-1-4.

(5) The assessment of the damage of a structure after a fire, is not covered by the present document.

### 1.2 Normative references

(1)P This European Standard incorporates by dated or undated reference, provisions from other publications. These normative references are cited at the appropriate places in the text, and the publications are listed hereafter. For dated references, subsequent amendments to or revisions of any of these publications apply to this European Standard only when incorporated in it by amendment or revision. For undated references the latest edition of the publication referred to applies (including amendments).

NOTE The following European Standards which are published or in preparation are cited in normative clauses:

prEN 13501-2, *Fire classification of construction products and building elements - Part 2: Classification using data from fire resistance tests, excluding ventilation services.*

EN 1990:2002, *Eurocode: Basis of structural design.*

EN 1991, *Eurocode 1: Actions on structures - Part 1-1: General actions - Densities, self-weight and imposed loads.*

prEN 1991, *Eurocode 1: Actions on structures - Part 1-3: General actions - Snow loads.*

prEN 1991, *Eurocode 1: Actions on structures - Part 1-4: General actions - Wind loads.*

prEN 1992, *Eurocode 2: Design of concrete structures.*

prEN 1993, *Eurocode 3: Design of steel structures.*

prEN 1994, *Eurocode 4: Design of composite steel and concrete structures.*

prEN 1995, *Eurocode 5: Design of timber structures.*

prEN 1996, *Eurocode 6: Design of masonry structures.*

prEN 1999, *Eurocode 9: Design of aluminium structures.*

### 1.3 Assumptions

(1)P In addition to the general assumptions of EN 1990 the following assumptions apply:

- any active and passive fire protection systems taken into account in the design will be adequately maintained;
- the choice of the relevant design fire scenario is made by appropriate qualified and experienced personnel, or is given by the relevant national regulation.

### 1.4 Distinction between Principles and Application Rules

(1) The rules given in EN 1990:2002, 1.4 apply.

### 1.5 Terms and definitions

(1)P For the purposes of this European Standard, the terms and definitions given in EN 1990:2002, 1.5 and the following apply.

#### 1.5.1 Common terms used in Eurocode Fire parts

##### 1.5.1.1

##### **equivalent time of fire exposure**

time of exposure to the standard temperature-time curve supposed to have the same heating effect as a real fire in the compartment

##### 1.5.1.2

##### **external member**

structural member located outside the building that may be exposed to fire through openings in the building enclosure

##### 1.5.1.3

##### **fire compartment**

space within a building, extending over one or several floors, which is enclosed by separating elements such that fire spread beyond the compartment is prevented during the relevant fire exposure

##### 1.5.1.4

##### **fire resistance**

ability of a structure, a part of a structure or a member to fulfil its required functions (load bearing function and/or fire separating function) for a specified load level, for a specified fire exposure and for a specified period of time

##### 1.5.1.5

##### **fully developed fire**

state of full involvement of all combustible surfaces in a fire within a specified space

##### 1.5.1.6

##### **global structural analysis (for fire)**

structural analysis of the entire structure, when either the entire structure, or only a part of it, are exposed to fire. Indirect fire actions are considered throughout the structure

**1.5.1.7**

**indirect fire actions**

internal forces and moments caused by thermal expansion

**1.5.1.8**

**integrity (E)**

ability of a separating element of building construction, when exposed to fire on one side, to prevent the passage through it of flames and hot gases and to prevent the occurrence of flames on the unexposed side

**1.5.1.9**

**insulation (I)**

ability of a separating element of building construction when exposed to fire on one side, to restrict the temperature rise of the unexposed face below specified levels

**1.5.1.10**

**load bearing function (R)**

ability of a structure or a member to sustain specified actions during the relevant fire, according to defined criteria

**1.5.1.11**

**member**

basic part of a structure (such as beam, column, but also assembly such as stud wall, truss,...) considered as isolated with appropriate boundary and support conditions

**1.5.1.12**

**member analysis (for fire)**

thermal and mechanical analysis of a structural member exposed to fire in which the member is assumed as isolated, with appropriate support and boundary conditions. Indirect fire actions are not considered, except those resulting from thermal gradients

**1.5.1.13**

**normal temperature design**

ultimate limit state design for ambient temperatures according to Part 1-1 of prEN 1992 to prEN 1996 or prEN 1999

**1.5.1.14**

**separating function**

ability of a separating element to prevent fire spread (e.g. by passage of flames or hot gases - cf integrity) or ignition beyond the exposed surface (cf insulation) during the relevant fire

**1.5.1.15**

**separating element**

load bearing or non-load bearing element (e.g. wall) forming part of the enclosure of a fire compartment

**1.5.1.16**

**standard fire resistance**

ability of a structure or part of it (usually only members) to fulfil required functions (load-bearing function and/or separating function), for the exposure to heating according to the standard temperature-time curve for a specified load combination and for a stated period of time

#### 1.5.1.17

##### **structural members**

load-bearing members of a structure including bracings

#### 1.5.1.18

##### **temperature analysis**

procedure of determining the temperature development in members on the basis of the thermal actions (net heat flux) and the thermal material properties of the members and of protective surfaces, where relevant

#### 1.5.1.19

##### **thermal actions**

actions on the structure described by the net heat flux to the members

### 1.5.2 Special terms relating to design in general

#### 1.5.2.1

##### **advanced fire model**

design fire based on mass conservation and energy conservation aspects

#### 1.5.2.2

##### **computational fluid dynamic model**

fire model able to solve numerically the partial differential equations giving, in all points of the compartment, the thermo-dynamical and aero-dynamical variables

#### 1.5.2.3

##### **fire wall**

separating element that is a wall separating two spaces (e.g. two buildings) that is designed for fire resistance and structural stability, and may include resistance to horizontal loading such that, in case of fire and failure of the structure on one side of the wall, fire spread beyond the wall is avoided

#### 1.5.2.4

##### **one-zone model**

fire model where homogeneous temperatures of the gas are assumed in the compartment

#### 1.5.2.5

##### **simple fire model**

design fire based on a limited application field of specific physical parameters

#### 1.5.2.6

##### **two-zone model**

fire model where different zones are defined in a compartment: the upper layer, the lower layer, the fire and its plume, the external gas and walls. In the upper layer, uniform temperature of the gas is assumed

### 1.5.3 Terms relating to thermal actions

#### 1.5.3.1

##### **combustion factor**

combustion factor represents the efficiency of combustion, varying between 1 for complete combustion to 0 for combustion fully inhibited

#### 1.5.3.2

##### **design fire**

specified fire development assumed for design purposes

### 1.5.3.3

#### **design fire load density**

fire load density considered for determining thermal actions in fire design; its value makes allowance for uncertainties

### 1.5.3.4

#### **design fire scenario**

specific fire scenario on which an analysis will be conducted

### 1.5.3.5

#### **external fire curve**

nominal temperature-time curve intended for the outside of separating external walls which can be exposed to fire from different parts of the facade, i.e. directly from the inside of the respective fire compartment or from a compartment situated below or adjacent to the respective external wall

### 1.5.3.6

#### **fire activation risk**

parameter taking into account the probability of ignition, function of the compartment area and the occupancy

### 1.5.3.7

#### **fire load density**

fire load per unit area related to the floor area  $q_f$ , or related to the surface area of the total enclosure, including openings,  $q_t$

### 1.5.3.8

#### **fire load**

sum of thermal energies which are released by combustion of all combustible materials in a space (building contents and construction elements)

### 1.5.3.9

#### **fire scenario**

qualitative description of the course of a fire with time identifying key events that characterise the fire and differentiate it from other possible fires. It typically defines the ignition and fire growth process, the fully developed stage, decay stage together with the building environment and systems that will impact on the course of the fire

### 1.5.3.10

#### **flash-over**

simultaneous ignition of all the fire loads in a compartment

### 1.5.3.11

#### **hydrocarbon fire curve**

nominal temperature-time curve for representing effects of an hydrocarbon type fire

### 1.5.3.12

#### **localised fire**

fire involving only a limited area of the fire load in the compartment

### 1.5.3.13

#### **opening factor**

factor representing the amount of ventilation depending on the area of openings in the compartment walls, on the height of these openings and on the total area of the enclosure surfaces



#### 1.5.3.14

##### **rate of heat release**

heat (energy) released by a combustible product as a function of time

#### 1.5.3.15

##### **standard temperature-time curve**

nominal curve defined in prEN 13501-2 for representing a model of a fully developed fire in a compartment

#### 1.5.3.16

##### **temperature-time curves**

gas temperature in the environment of member surfaces as a function of time. They may be:

- **nominal:** conventional curves, adopted for classification or verification of fire resistance, e.g. the standard temperature-time curve, external fire curve, hydrocarbon fire curve;
- **parametric:** determined on the basis of fire models and the specific physical parameters defining the conditions in the fire compartment

### 1.5.4 Terms relating to heat transfer analysis

#### 1.5.4.1

##### **configuration factor**

configuration factor for radiative heat transfer from surface A to surface B is defined as the fraction of diffusely radiated energy leaving surface A that is incident on surface B

#### 1.5.4.2

##### **convective heat transfer coefficient**

convective heat flux to the member related to the difference between the bulk temperature of gas bordering the relevant surface of the member and the temperature of that surface

#### 1.5.4.3

##### **emissivity**

equal to absorptivity of a surface, i.e. the ratio between the radiative heat absorbed by a given surface and that of a black body surface

#### 1.5.4.4

##### **net heat flux**

energy, per unit time and surface area, definitely absorbed by members

## 1.6 Symbols

(1)P For the purpose of this Part 1-2, the following symbols apply.

*Latin upper case letters*

A	area of the fire compartment
$A_{ind,d}$	design value of indirect action due to fire
$A_f$	floor area of the fire compartment
$A_{fi}$	fire area
$A_h$	area of horizontal openings in roof of compartment

$A_{h,v}$	total area of openings in enclosure ( $A_{h,v} = A_h + A_v$ )
$A_j$	area of enclosure surface $j$ , openings not included
$A_t$	total area of enclosure (walls, ceiling and floor, including openings)
$A_v$	total area of vertical openings on all walls ( $A_v = \sum_i A_{v,i}$ )
$A_{v,i}$	area of window "i"
$C_i$	protection coefficient of member face $i$
$D$	depth of the fire compartment, diameter of the fire
$E_d$	design value of the relevant effects of actions from the fundamental combination according to EN 1990
$E_{fi,d}$	constant design value of the relevant effects of actions in the fire situation
$E_{fi,d,t}$	design value of the relevant effects of actions in the fire situation at time $t$
$E_g$	internal energy of gas
$H$	distance between the fire source and the ceiling
$H_u$	net calorific value including moisture
$H_{u0}$	net calorific value of dry material
$H_{ui}$	net calorific value of material $i$
$L_c$	length of the core
$L_f$	flame length along axis
$L_H$	horizontal projection of the flame (from the facade)
$L_h$	horizontal flame length
$L_L$	flame height (from the upper part of the window)
$L_x$	axis length from window to the point where the calculation is made
$M_{k,i}$	amount of combustible material $i$
$O$	opening factor of the fire compartment ( $O = A_v \sqrt{h_{eq}} / A_t$ )
$O_{lim}$	reduced opening factor in case of fuel controlled fire
$P_{int}$	the internal pressure
$Q$	rate of heat release of the fire
$Q_c$	convective part of the rate of heat release $Q$
$Q_{fi,k}$	characteristic fire load

$Q_{fi,k,i}$	characteristic fire load of material $i$
$Q_D^*$	heat release coefficient related to the diameter $D$ of the local fire
$Q_H^*$	heat release coefficient related to the height $H$ of the compartment
$Q_{k,1}$	characteristic leading variable action
$Q_{max}$	maximum rate of heat release
$Q_{in}$	rate of heat release entering through openings by gas flow
$Q_{out}$	rate of heat release lost through openings by gas flow
$Q_{rad}$	rate of heat release lost by radiation through openings
$Q_{wall}$	rate of heat release lost by radiation and convection to the surfaces of the compartment
$R$	ideal gas constant (= 287 [J/kgK])
$R_d$	design value of the resistance of the member at normal temperature
$R_{fi,d,t}$	design value of the resistance of the member in the fire situation at time $t$
$RHR_f$	maximum rate of heat release per square meter
$T$	the temperature [K]
$T_{amb}$	the ambient temperature [K]
$T_0$	initial temperature (= 293 [K])
$T_f$	temperature of the fire compartment [K]
$T_g$	gas temperature [K]
$T_w$	flame temperature at the window [K]
$T_z$	flame temperature along the flame axis [K]
$W$	<span style="border: 1px solid black; padding: 0 2px;">AC1</span> width of wall containing window(s) ( $W_1$ ) <span style="border: 1px solid black; padding: 0 2px;">AC1</span>
$W_1$	width of the wall 1, assumed to contain the greatest window area
$W_2$	width of the wall of the fire compartment, perpendicular to wall $W_1$
$W_a$	horizontal projection of an awning or balcony
$W_c$	width of the core
<i>Latin lower case letters</i>	
$b$	thermal absorptivity for the total enclosure ( $b = \sqrt{(\rho c \lambda)}$ )

$b_i$	thermal absorptivity of layer $i$ of one enclosure surface
$b_j$	thermal absorptivity of one enclosure surface $j$
$c$	specific heat
$d_{eq}$	geometrical characteristic of an external structural element (diameter or side)
$d_f$	flame thickness
$d_i$	cross-sectional dimension of member face $i$
$g$	the gravitational acceleration
$h_{eq}$	weighted average of window heights on all walls $\left( h_{eq} = \left( \sum_i (A_{v,i} h_i) \right) / A_v \right)$
$h_i$	height of window $i$
$\dot{h}$	heat flux to unit surface area
$\dot{h}_{net}$	net heat flux to unit surface area
$\dot{h}_{net,c}$	net heat flux to unit surface area due to convection
$\dot{h}_{net,r}$	net heat flux to unit surface area due to radiation
$\dot{h}_{tot}$	total heat flux to unit surface area
$\dot{h}_i$	heat flux to unit surface area due to fire $i$
$k$	correction factor
$k_b$	conversion factor
$k_c$	correction factor
$m$	mass, combustion factor
$\dot{m}$	mass rate
$\dot{m}_{in}$	rate of gas mass coming in through the openings
$\dot{m}_{out}$	rate of gas mass going out through the openings
$\dot{m}_{fi}$	rate of pyrolysis products generated
$q_f$	fire load per unit area related to the floor area $A_f$
$q_{f,d}$	design fire load density related to the floor area $A_f$
$q_{f,k}$	characteristic fire load density related to the surface area $A_f$
$q_t$	fire load per unit area related to the surface area $A_f$

$q_{t,d}$	design fire load density related to the surface area $A_t$
$q_{t,k}$	characteristic fire load density related to the surface area $A_t$
$r$	horizontal distance between the vertical axis of the fire and the point along the ceiling where the thermal flux is calculated
$s_i$	thickness of layer $i$
$s_{lim}$	limit thickness
$t$	time
$t_{e,d}$	equivalent time of fire exposure
$t_{fi,d}$	design fire resistance (property of the member or structure)
$t_{fi,requ}$	required fire resistance time
$t_{lim}$	time for maximum gas temperature in case of fuel controlled fire
$t_{max}$	time for maximum gas temperature
$t_\alpha$	fire growth rate coefficient
$u$	wind speed, moisture content
$w_i$	width of window "i"
$w_t$	sum of window widths on all walls ( $w_t = \sum w_i$ ); ventilation factor referred to $A_t$
$w_f$	width of the flame; ventilation factor
$y$	coefficient parameter
$z$	height
$z_0$	virtual origin of the height $z$
$z'$	vertical position of the virtual heat source

*Greek upper case letters*

$\Phi$	configuration factor
$\Phi_f$	overall configuration factor of a member for radiative heat transfer from an opening
$\Phi_{f,i}$	configuration factor of member face $i$ for a given opening
$\Phi_z$	overall configuration factor of a member for radiative heat transfer from a flame
$\Phi_{z,i}$	configuration factor of member face $i$ for a given flame
$\Gamma$	time factor function of the opening factor $O$ and the thermal absorptivity $b$
$\Gamma_{lim}$	time factor function of the opening factor $O_{lim}$ and the thermal absorptivity $b$

$\theta$	temperature [°C]; $\theta$ [°C] = $T$ [K] - 273
$\theta_{cr,d}$	design value of the critical material temperature [°C]
$\theta_d$	design value of material temperature [°C]
$\theta_g$	gas temperature in the fire compartment, or near the member [°C]
$\theta_m$	temperature of the member surface [°C]
$\theta_{max}$	maximum temperature [°C]
$\theta_r$	effective radiation temperature of the fire environment [°C]
$\Omega$	$(A_f \cdot q_{f,d}) / (A_v \cdot A_f)^{1/2}$
$\Psi_f$	protected fire load factor
<i>Greek lower case letters</i>	
$\alpha_c$	coefficient of heat transfer by convection
$\alpha_h$	area of horizontal openings related to the floor area
$\alpha_v$	area of vertical openings related to the floor area
$\delta_{ni}$	factor accounting for the existence of a specific fire fighting measure $i$
$\delta_{q1}$	factor taking into account the fire activation risk due to the size of the compartment
$\delta_{q2}$	factor taking into account the fire activation risk due to the type of occupancy
$\epsilon_m$	surface emissivity of the member
$\epsilon_f$	emissivity of flames, of the fire
$\eta_{fi}$	reduction factor
$\eta_{fi,t}$	load level for fire design
$\lambda$	thermal conductivity
$\rho$	density
$\rho_g$	internal gas density
$\sigma$	Stephan Boltzmann constant (= $5,67 \cdot 10^{-8}$ [W/m <sup>2</sup> K <sup>4</sup> ])
$\tau_F$	free burning fire duration (assumed to be 1 200 [s])
$\psi_0$	combination factor for the characteristic value of a variable action
$\psi_1$	combination factor for the frequent value of a variable action
$\psi_2$	combination factor for the quasi-permanent value of a variable action

## Section 2 Structural Fire design procedure

### 2.1 General

(1) A structural fire design analysis should take into account the following steps as relevant:

- selection of the relevant design fire scenarios;
- determination of the corresponding design fires;
- calculation of temperature evolution within the structural members;
- calculation of the mechanical behaviour of the structure exposed to fire.

NOTE Mechanical behaviour of a structure is depending on thermal actions and their thermal effect on material properties and indirect mechanical actions, as well as on the direct effect of mechanical actions.

(2) Structural fire design involves applying actions for temperature analysis and actions for mechanical analysis according to this Part and other Parts of EN 1991.

(3)P Actions on structures from fire exposure are classified as accidental actions, see EN 1990:2002, 6.4.3.3(4).

### 2.2 Design fire scenario

(1) To identify the accidental design situation, the relevant design fire scenarios and the associated design fires should be determined on the basis of a fire risk assessment.

(2) For structures where particular risks of fire arise as a consequence of other accidental actions, this risk should be considered when determining the overall safety concept.

(3) Time- and load-dependent structural behaviour prior to the accidental situation needs not be considered, unless (2) applies.

### 2.3 Design fire

(1) For each design fire scenario, a design fire, in a fire compartment, should be estimated according to section 3 of this Part.

(2) The design fire should be applied only to one fire compartment of the building at a time, unless otherwise specified in the design fire scenario.

(3) For structures, where the national authorities specify structural fire resistance requirements, it may be assumed that the relevant design fire is given by the standard fire, unless specified otherwise.

### 2.4 Temperature Analysis

(1)P When performing temperature analysis of a member, the position of the design fire in relation to the member shall be taken into account.

(2) For external members, fire exposure through openings in facades and roofs should be considered.

(3) For separating external walls fire exposure from inside (from the respective fire compartment) and alternatively from outside (from other fire compartments) should be considered when required.

(4) Depending on the design fire chosen in section 3, the following procedures should be used:

- with a nominal temperature-time curve, the temperature analysis of the structural members is made for a specified period of time, without any cooling phase;

NOTE 1 The specified period of time may be given in the national regulations or obtained from annex F following the specifications of the national annex.

- with a fire model, the temperature analysis of the structural members is made for the full duration of the fire, including the cooling phase.

NOTE 2 Limited periods of fire resistance may be set in the national annex.

## **2.5 Mechanical Analysis**

(1)P The mechanical analysis shall be performed for the same duration as used in the temperature analysis.

(2) Verification of fire resistance should be in the time domain:

$$t_{fi,d} \geq t_{fi,requ} \quad (2.1)$$

or in the strength domain:

$$R_{fi,d,t} \geq E_{fi,d,t} \quad (2.2)$$

or in the temperature domain:

$$\theta_d \leq \theta_{cr,d} \quad (2.3)$$

where

$t_{fi,d}$  is the design value of the fire resistance

$t_{fi,requ}$  is the required fire resistance time

$R_{fi,d,t}$  is the design value of the resistance of the member in the fire situation at time  $t$

$E_{fi,d,t}$  is the design value of the relevant effects of actions in the fire situation at time  $t$

$\theta_d$  is the design value of material temperature

$\theta_{cr,d}$  is the design value of the critical material temperature



## Section 3 Thermal actions for temperature analysis

### 3.1 General rules

(1) Thermal actions are given by the net heat flux  $\dot{h}_{\text{net}}$  [W/m<sup>2</sup>] to the surface of the member.

(2) On the fire exposed surfaces the net heat flux  $\dot{h}_{\text{net}}$  should be determined by considering heat transfer by convection and radiation as

$$\dot{h}_{\text{net}} = \dot{h}_{\text{net,c}} + \dot{h}_{\text{net,r}} \quad [\text{W/m}^2] \quad (3.1)$$

where

$\dot{h}_{\text{net,c}}$  is given by e.q. (3.2)

$\dot{h}_{\text{net,r}}$  is given by e.q. (3.3)

(3) The net convective heat flux component should be determined by:

$$\dot{h}_{\text{net,c}} = \alpha_c \cdot (\Theta_g - \Theta_m) \quad [\text{W/m}^2] \quad (3.2)$$

where

$\alpha_c$  is the coefficient of heat transfer by convection [W/m<sup>2</sup>K]

$\Theta_g$  is the gas temperature in the vicinity of the fire exposed member [°C]

$\Theta_m$  is the surface temperature of the member [°C]

(4) For the coefficient of heat transfer by convection  $\alpha_c$  relevant for nominal temperature-time curves, see 3.2.

(5) On the unexposed side of separating members, the net heat flux  $\dot{h}_{\text{net}}$  should be determined by using equation (3.1), with  $\alpha_c = 4$  [W/m<sup>2</sup>K]. The coefficient of heat transfer by convection should be taken as  $\alpha_c = 9$  [W/m<sup>2</sup>K], when assuming it contains the effects of heat transfer by radiation.

(6) The net radiative heat flux component per unit surface area is determined by:

$$\dot{h}_{\text{net,r}} = \Phi \cdot \varepsilon_m \cdot \varepsilon_f \cdot \sigma \cdot [(\Theta_f + 273)^4 - (\Theta_m + 273)^4] \quad [\text{W/m}^2] \quad (3.3)$$

where

$\Phi$  is the configuration factor

$\varepsilon_m$  is the surface emissivity of the member

$\varepsilon_f$  is the emissivity of the fire

$\sigma$  is the Stephan Boltzmann constant (= 5,67 · 10<sup>-8</sup> W/m<sup>2</sup>K<sup>4</sup>)

$\Theta_f$  is the effective radiation temperature of the fire environment [°C]

$\Theta_m$  is the surface temperature of the member [°C]

NOTE 1 Unless given in the material related fire design Parts of prEN 1992 to prEN 1996 and prEN 1999,  $\varepsilon_m = 0,8$  may be used.

NOTE 2 The emissivity of the fire is taken in general as  $\varepsilon_f = 1,0$ .

(7) Where this Part or the fire design Parts of prEN 1992 to prEN 1996 and prEN 1999 give no specific data, the configuration factor should be taken as  $\Phi = 1,0$ . A lower value may be chosen to take account of so called position and shadow effects.

NOTE For the calculation of the configuration factor  $\Phi$  a method is given in annex G.

(8) In case of fully fire engulfed members, the radiation temperature  $\Theta_r$  may be represented by the gas temperature  $\Theta_g$  around that member.

(9) The surface temperature  $\Theta_m$  results from the temperature analysis of the member according to the fire design Parts 1-2 of prEN 1992 to prEN 1996 and prEN 1999, as relevant.

(10) Gas temperatures  $\Theta_g$  may be adopted as nominal temperature-time curves according to 3.2, or adopted according to the fire models given in 3.3.

NOTE The use of the nominal temperature-time curves according to 3.2 or, as an alternative, the use of the natural fire models according to 3.3 may be specified in the national annex.

## **3.2 Nominal temperature-time curves**

### **3.2.1 Standard temperature-time curve**

(1) The standard temperature-time curve is given by:

$$\Theta_g = 20 + 345 \log_{10} (8 t + 1) \quad [^{\circ}\text{C}] \quad (3.4)$$

where

$\Theta_g$  is the gas temperature in the fire compartment  $[^{\circ}\text{C}]$

$t$  is the time  $[\text{min}]$

(2) The coefficient of heat transfer by convection is:

$$\alpha_c = 25 \text{ W/m}^2\text{K}$$

### **3.2.2 External fire curve**

(1) The external fire curve is given by:

$$\Theta_g = 660 ( 1 - 0,687 e^{-0,32 t} - 0,313 e^{-3,8 t} ) + 20 \quad [^{\circ}\text{C}] \quad (3.5)$$

where

$\Theta_g$  is the gas temperature near the member  $[^{\circ}\text{C}]$

$t$  is the time  $[\text{min}]$

(2) The coefficient of heat transfer by convection is:

$$\alpha_c = 25 \text{ W/m}^2\text{K}$$

### 3.2.3 Hydrocarbon curve

(1) The hydrocarbon temperature-time curve is given by:

$$\theta_g = 1\,080 (1 - 0,325 e^{-0,167 t} - 0,675 e^{-2,5 t}) + 20 \quad [^\circ\text{C}] \quad (3.6)$$

where

$\theta_g$  is the gas temperature in the fire compartment [ $^\circ\text{C}$ ]

$t$  is the time [min]

(2) The coefficient of heat transfer by convection is: (3.7)

$$\alpha_c = 50 \text{ W/m}^2\text{K}$$

## 3.3 Natural fire models

### 3.3.1 Simplified fire models

#### 3.3.1.1 General

(1) Simple fire models are based on specific physical parameters with a limited field of application.

NOTE For the calculation of the design fire load density  $q_{f,d}$  a method is given in annex E.

(2) A uniform temperature distribution as a function of time is assumed for compartment fires. A non-uniform temperature distribution as a function of time is assumed in case of localised fires.

(3) When simple fire models are used, the coefficient of heat transfer by convection should be taken as  $\alpha_c = 35 \text{ [W/m}^2\text{K]}$ .

#### 3.3.1.2 Compartment fires

(1) Gas temperatures should be determined on the basis of physical parameters considering at least the fire load density and the ventilation conditions.

NOTE 1 The national annex may specify the procedure for calculating the heating conditions.

NOTE 2 For internal members of fire compartments, a method for the calculation of the gas temperature in the compartment is given in annex A.

(2) For external members, the radiative heat flux component should be calculated as the sum of the contributions of the fire compartment and of the flames emerging from the openings.

NOTE For external members exposed to fire through openings in the facade, a method for the calculation of the heating conditions is given in annex B.

### 3.3.1.3 Localised fires

(1) Where flash-over is unlikely to occur, thermal actions of a localised fire should be taken into account.

NOTE The national annex may specify the procedure for calculating the heating conditions. A method for the calculation of thermal actions from localised fires is given in annex C.

### 3.3.2 Advanced fire models

(1) Advanced fire models should take into account the following:

- gas properties;
- mass exchange;
- energy exchange.

NOTE 1 Available calculation methods normally include iterative procedures.

NOTE 2 For the calculation of the design fire load density  $q_{f,d}$  a method is given in annex E.

NOTE 3 For the calculation of the rate of heat release  $Q$  a method is given in annex E.

(2) One of the following models should be used:

- one-zone models assuming a uniform, time dependent temperature distribution in the compartment;
- two-zone models assuming an upper layer with time dependent thickness and with time dependent uniform temperature, as well as a lower layer with a time dependent uniform and lower temperature;
- Computational Fluid Dynamic models giving the temperature evolution in the compartment in a completely time dependent and space dependent manner.

NOTE The national annex may specify the procedure for calculating the heating conditions. A method for the calculation of thermal actions in case of one-zone, two-zone or computational fluid dynamic models is given in annex D.

(3) The coefficient of heat transfer by convection should be taken as  $\alpha_c = 35 \text{ [W/m}^2\text{K]}$ , unless more detailed information is available.

(4) In order to calculate more accurately the temperature distribution along a member, in case of a localised fire, a combination of results obtained with a two-zone model and a localised fire approach may be considered.

NOTE The temperature field in the member may be obtained by considering the maximum effect at each location given by the two fire models.

## Section 4 Mechanical actions for structural analysis

### 4.1 General

(1)P Imposed and constrained expansions and deformations caused by temperature changes due to fire exposure result in effects of actions, e.g. forces and moments, which shall be considered with the exception of those cases where they:

- may be recognized a priori to be either negligible or favourable;
- are accounted for by conservatively chosen support models and boundary conditions, and/or implicitly considered by conservatively specified fire safety requirements.

(2) For an assessment of indirect actions the following should be considered:

- constrained thermal expansion of the members themselves, e.g. columns in multi-storey frame structures with stiff walls;
- differing thermal expansion within statically indeterminate members, e.g. continuous floor slabs;
- thermal gradients within cross-sections giving internal stresses;
- thermal expansion of adjacent members, e.g. displacement of a column head due to the expanding floor slab, or expansion of suspended cables;
- thermal expansion of members affecting other members outside the fire compartment.

(3) Design values of indirect actions due to fire  $A_{ind,d}$  should be determined on the basis of the design values of the thermal and mechanical material properties given in the fire design Parts of prEN 1992 to prEN 1996 and prEN 1999 and the relevant fire exposure.

(4) Indirect actions from adjacent members need not be considered when fire safety requirements refer to members under standard fire conditions.

### 4.2 Simultaneity of actions

#### 4.2.1 Actions from normal temperature design

(1)P Actions shall be considered as for normal temperature design, if they are likely to act in the fire situation.

(2) Representative values of variable actions, accounting for the accidental design situation of fire exposure, should be introduced in accordance with EN 1990.

(3) Decrease of imposed loads due to combustion should not be taken into account.

(4) Cases where snow loads need not be considered, due to the melting of snow, should be assessed individually.

(5) Actions resulting from industrial operations need not be taken into account.

#### 4.2.2 Additional actions

- (1) Simultaneous occurrence with other independent accidental actions needs not be considered.
- (2) Depending on the accidental design situations to be considered, additional actions induced by the fire may need to be applied during fire exposure, e.g. impact due to collapse of a structural member or heavy machinery.

NOTE The choice of additional actions may be specified in the national annex.

- (3) Fire walls may be required to resist a horizontal impact load according to EN 1363-2.

#### 4.3 Combination rules for actions

##### 4.3.1 General rule

- (1)P For obtaining the relevant effects of actions  $E_{fi,d,t}$  during fire exposure, the mechanical actions shall be combined in accordance with EN 1990 "Basis of structural design" for accidental design situations.
- (2) The representative value of the variable action  $Q_1$  may be considered as the quasi-permanent value  $\psi_{2,1} Q_1$ , or as an alternative the frequent value  $\psi_{1,1} Q_1$ .

NOTE The use of the quasi-permanent value  $\psi_{2,1} Q_1$  or the frequent value  $\psi_{1,1} Q_1$  may be specified in the national annex. The use of  $\psi_{2,1} Q_1$  is recommended.

##### 4.3.2 Simplified rules

- (1) Where indirect fire actions need not be explicitly considered, effects of actions may be determined by analysing the structure for combined actions according to 4.3.1 for  $t = 0$  only. These effects of actions  $E_{fi,d}$  may be applied as constant throughout fire exposure.

NOTE This clause applies, for example, to effects of actions at boundaries and supports, where an analysis of parts of the structure is performed in accordance with the fire design Parts of prEN 1992 to prEN 1996 and prEN 1999.

- (2) As a further simplification to (1), effects of actions may be deduced from those determined in normal temperature design:

$$E_{fi,d,t} = E_{fi,d} = \eta_{fi} \cdot E_d \quad (4.1)$$

where

$E_d$  is the design value of the relevant effects of actions from the fundamental combination according to EN 1990;

$E_{fi,d}$  is the corresponding constant design value in the fire situation;

$\eta_{fi}$  is a reduction factor defined in the fire design Parts of prEN 1992 to prEN 1996 and prEN 1999.

### 4.3.3 Load level

(1) Where tabulated data are specified for a reference load level, this load level corresponds to:

$$E_{fi,d,t} = \eta_{fi,t} \cdot R_d \quad (4.2)$$

where

$R_d$  is the design value of the resistance of the member at normal temperature, determined according to prEN 1992 to prEN 1996 and prEN 1999;

$\eta_{fi,t}$  is the load level for fire design.

## Annex A (informative)

### Parametric temperature-time curves

(1) The following temperature-time curves are valid for fire compartments up to 500 m<sup>2</sup> of floor area, without openings in the roof and for a maximum compartment height of 4 m. It is assumed that the fire load of the compartment is completely burnt out.

(2) If fire load densities are specified without specific consideration to the combustion behaviour (see annex E), then this approach should be limited to fire compartments with mainly cellulosic type fire loads.

(3) The temperature-time curves in the heating phase are given by:

$$\theta_g = 20 + 1\,325 \left( 1 - 0,324 e^{-0,2t^*} - 0,204 e^{-1,7t^*} - 0,472 e^{-19t^*} \right) \quad (\text{A.1})$$

where

$\theta_g$  is the gas temperature in the fire compartment [°C]

$$t^* = t \cdot \Gamma \quad [\text{h}] \quad (\text{A.2a})$$

with

$t$  time [h]

$$\Gamma = [O/b]^2 / (0,04/1\,160)^2 \quad [-]$$

$$b = \sqrt{(\rho c \lambda)}$$

with the following limits:  $100 \leq b \leq 2\,200$  [J/m<sup>2</sup>s<sup>1/2</sup>K]

$\rho$  density of boundary of enclosure [kg/m<sup>3</sup>]

$c$  specific heat of boundary of enclosure [J/kgK]

$\lambda$  thermal conductivity of boundary of enclosure [W/mK]

$O$  opening factor:  $A_v \sqrt{h_{\text{eq}}} / A_t$  [m<sup>1/2</sup>]

with the following limits:  $0,02 \leq O \leq 0,20$

$A_v$  total area of vertical openings on all walls [m<sup>2</sup>]

$h_{\text{eq}}$  weighted average of window heights on all walls [m]

$A_t$  total area of enclosure (walls, ceiling and floor, including openings) [m<sup>2</sup>]

NOTE In case of  $\Gamma = 1$ , equation (A.1) approximates the standard temperature-time curve.

(4) For the calculation of the  $b$  factor, the density  $\rho$ , the specific heat  $c$  and the thermal conductivity  $\lambda$  of the boundary may be taken at ambient temperature.



(5) To account for an enclosure surface with different layers of material,  $b = \sqrt{(\rho c \lambda)}$  should be introduced as:

– If  $b_1 < b_2$ ,  $b = b_1$  (A.3)

– If  $b_1 > b_2$ , a limit thickness  $s_{lim}$  is calculated for the exposed material according to:

$$s_{lim} = \sqrt{\frac{3\,600\ t_{max}\ \lambda_1}{c_1\ \rho_1}} \quad \text{with } t_{max} \text{ given by eq. A.7.} \quad [m] \quad (A.4)$$

If  $s_1 > s_{lim}$  then  $b = b_1$  (A.4a)

If  $s_1 < s_{lim}$  then  $b = \frac{s_1}{s_{lim}} b_1 + \left(1 - \frac{s_1}{s_{lim}}\right) b_2$  (A.4b)

where

the indice 1 represents the layer directly exposed to the fire, the indice 2 the next layer...

$s_i$  is the thickness of layer i

$$b_i = \sqrt{(\rho_i c_i \lambda_i)}$$

$\rho_i$  is the density of the layer i

$c_i$  is the specific heat of the layer i

$\lambda_i$  is the thermal conductivity of the layer i

(6) To account for different  $b$  factors in walls, ceiling and floor,  $b = \sqrt{(\rho c \lambda)}$  should be introduced as:

$$b = (\Sigma(b_j A_j)) / (A_t - A_v) \quad (A.5)$$

where

$A_j$  is the area of enclosure surface j, openings not included

$b_j$  is the thermal property of enclosure surface j according to equations (A.3) and (A.4)

(7) The maximum temperature  $\Theta_{max}$  in the heating phase happens for  $t^* = t_{max}^*$

$$t_{max}^* = t_{max} \cdot \Gamma \quad [h] \quad (A.6)$$

$$\text{with } t_{max} = \max [(0,2 \cdot 10^{-3} \cdot q_{t,d} / O) ; t_{lim}] \quad [h] \quad (A.7)$$

where

$q_{t,d}$  is the design value of the fire load density related to the total surface area  $A_t$  of the enclosure whereby  $q_{t,d} = q_{t,d} \cdot A_f / A_t$  [MJ/m<sup>2</sup>]. The following limits should be observed:  $50 \leq q_{t,d} \leq 1\,000$  [MJ/m<sup>2</sup>].

$q_{f,d}$  is the design value of the fire load density related to the surface area  $A_f$  of the floor [MJ/m<sup>2</sup>] taken from annex E.

$t_{lim}$  is given by (10) in [h].

NOTE The time  $t_{max}$  corresponding to the maximum temperature is given by  $t_{lim}$  in case the fire is fuel controlled. If  $t_{lim}$  is given by  $(0,2 \cdot 10^{-3} \cdot q_{t,d} / O)$ , the fire is ventilation controlled.

(8) When  $t_{\max} = t_{\text{lim}}$ ,  $t^*$  used in equation (A.1) is replaced by:

$$t^* = t \cdot \Gamma_{\text{lim}} \quad [\text{h}] \quad (\text{A.2b})$$

$$\text{with } \Gamma_{\text{lim}} = [O_{\text{lim}}/b]^2 / (0,04/1\ 160)^2 \quad (\text{A.8})$$

$$\text{where } O_{\text{lim}} = 0,1 \cdot 10^{-3} \cdot q_{\text{t,d}} / t_{\text{lim}} \quad (\text{A.9})$$

(9) If ( $O > 0,04$  and  $q_{\text{t,d}} < 75$  and  $b < 1\ 160$ ),  $\Gamma_{\text{lim}}$  in (A.8) has to be multiplied by  $k$  given by:

$$k = 1 + \left( \frac{O - 0,04}{0,04} \right) \left( \frac{q_{\text{t,d}} - 75}{75} \right) \left( \frac{1160 - b}{1160} \right) \quad (\text{A.10})$$

(10) In case of slow fire growth rate,  $t_{\text{lim}} = 25$  min; in case of medium fire growth rate,  $t_{\text{lim}} = 20$  min and in case of fast fire growth rate,  $t_{\text{lim}} = 15$  min.

NOTE For advice on fire growth rate, see Table E.5 in annex E.

(11) The temperature-time curves in the cooling phase are given by:

$$\Theta_{\text{g}} = \Theta_{\max} - 625 (t^* - t_{\max}^* \cdot x) \quad \text{for } t_{\max}^* \leq 0,5 \quad (\text{A.11a})$$

$$\Theta_{\text{g}} = \Theta_{\max} - 250 (3 - t_{\max}^*) (t^* - t_{\max}^* \cdot x) \quad \text{for } 0,5 < t_{\max}^* < 2 \quad (\text{A.11b})$$

$$\Theta_{\text{g}} = \Theta_{\max} - 250 (t^* - t_{\max}^* \cdot x) \quad \text{for } t_{\max}^* \geq 2 \quad (\text{A.11c})$$

where  $t^*$  is given by (A.2a)

$$t_{\max}^* = (0,2 \cdot 10^{-3} \cdot q_{\text{t,d}} / O) \cdot \Gamma \quad (\text{A.12})$$

$$x = 1,0 \text{ if } t_{\max} > t_{\text{lim}}, \text{ or } x = t_{\text{lim}} \cdot \Gamma / t_{\max}^* \text{ if } t_{\max} = t_{\text{lim}}$$

## Annex B (informative)

### Thermal actions for external members - Simplified calculation method

#### B.1 Scope

(1) This method allows the determination of:

- the maximum temperatures of a compartment fire;
- the size and temperatures of the flame from openings;
- radiation and convection parameters.

(2) This method considers steady-state conditions for the various parameters. The method is valid only for fire loads  $q_{f,d}$  higher than 200 MJ/m<sup>2</sup>.

#### B.2 Conditions of use

(1) When there is more than one window in the relevant fire compartment, the weighted average height of windows  $h_{eq}$ , the total area of vertical openings  $A_v$  and the sum of window widths ( $w_i = \sum w_i$ ) are used.

(2) When there are windows in only wall 1, the ratio  $D/W$  is given by:

$$\boxed{\text{AC1}} \quad D/W = \frac{W_2}{W_1} \quad \boxed{\text{AC1}} \quad \text{(B.1)}$$

(3) When there are windows on more than one wall, the ratio  $D/W$  has to be obtained as follows:

$$D/W = \frac{W_2}{W_1} \frac{A_{v1}}{A_v} \quad \text{(B.2)}$$

where

$W_1$  is the width of the wall 1, assumed to contain the greatest window area;

$A_{v1}$  is the sum of window areas on wall 1;

$W_2$  is the width of the wall perpendicular to wall 1 in the fire compartment.

(4) When there is a core in the fire compartment, the ratio  $D/W$  has to be obtained as follows:

- limits given in (7) apply;
- $L_c$  and  $W_c$  are the length and width of the core;
- $W_1$  and  $W_2$  are the length and width of the fire compartment:

$$D/W = \frac{(W_2 - L_c) A_{v1}}{(W_1 - W_c) A_v} \quad \text{(B.3)}$$

(5) All parts of an external wall that do not have the fire resistance (REI) required for the stability of the building should be classified as window areas.

(6) The total area of windows in an external wall is:

- the total area, according to (5), if it is less than 50 % of the area of the relevant external wall of the compartment;
- firstly the total area and secondly 50 % of the area of the relevant external wall of the compartment if, according to (5), the area is more than 50 %. These two situations should be considered for calculation. When using 50 % of the area of the external wall, the location and geometry of the open surfaces should be chosen so that the most severe case is considered.

(7) The size of the fire compartment should not exceed 70 m in length, 18 m in width and 5 m in height.

(8) The flame temperature should be taken as uniform across the width and the thickness of the flame.

### B.3 Effects of wind


#### B.3.1 Mode of ventilation

(1)P If there are windows on opposite sides of the fire compartment or if additional air is being fed to the fire from another source (other than windows), the calculation shall be done with forced draught conditions. Otherwise, the calculation is done with no forced draught conditions.

#### B.3.2 Flame deflection by wind

(1) Flames from an opening should be assumed to be leaving the fire compartment (see Figure B.1):

- perpendicular to the facade;
- with a deflection of  $45^\circ$  due to wind effects.

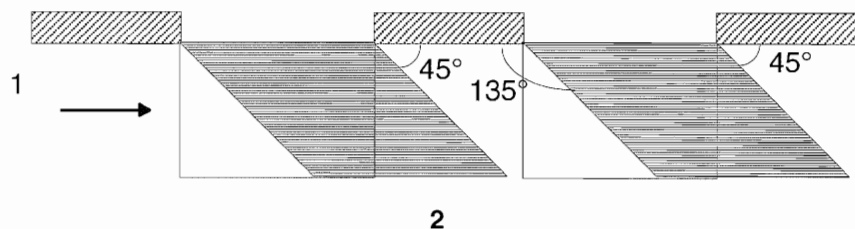

#### Key

- 1 Wind  
2 Horizontal cross section

Figure B.1 — Deflection of flame by wind

## B.4 Characteristics of fire and flames

### B.4.1 No forced draught

(1) The rate of burning or the rate of heat release is given by:

$$Q = \min \left( A_f \cdot q_{f,d} / \tau_F ; 3,15 (1 - e^{-0,036/O}) A_v \left( \frac{h_{eq}}{D/W} \right)^{1/2} \right) \quad [\text{MW}] \quad (\text{B.4})$$

(2) The temperature of the fire compartment is given by:


$$T_f = 6000 (1 - e^{-0,1/O}) O^{1/2} (1 - e^{-0,00286 \Omega}) + T_0 \quad (\text{B.5})$$

(3) The flame height (see Figure B.2) is given by:

$$L_L = \max \left( 0 ; h_{eq} \left( 2,37 \left( \frac{Q}{A_v \rho_g (h_{eq} g)^{1/2}} \right)^{2/3} - 1 \right) \right) \quad (\text{B.6})$$

NOTE With  $\rho_g = 0,45 \text{ kg/m}^3$  and  $g = 9,81 \text{ m/s}^2$ , this equation may be simplified to:

$$L_L = 1,9 \left( \frac{Q}{w_t} \right)^{2/3} - h_{eq} \quad (\text{B.7})$$

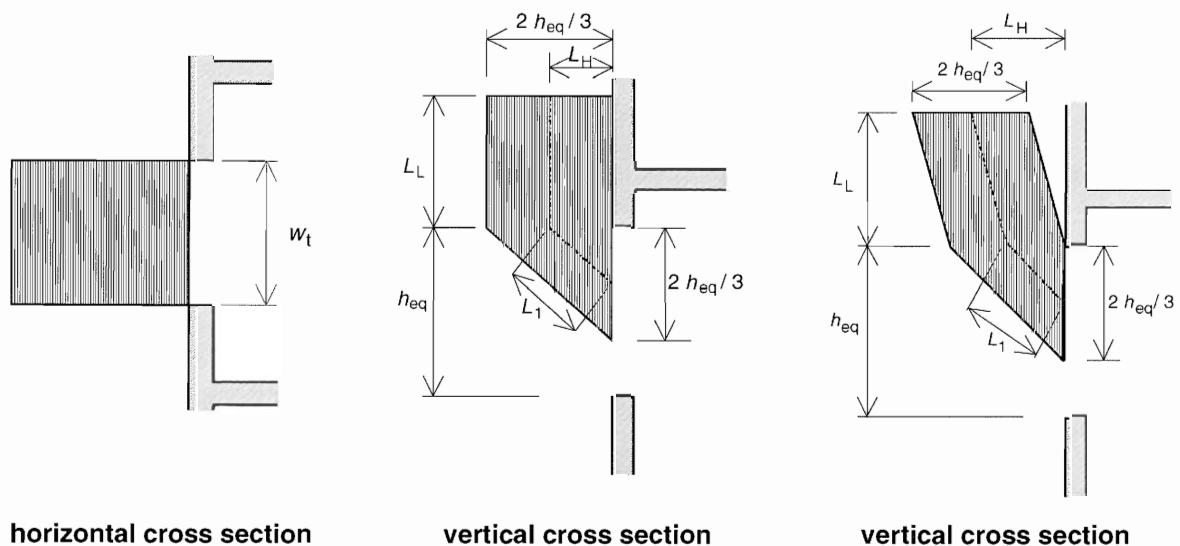

$L_L = \frac{h_{eq}}{3} \Rightarrow$	$L_1 = \sqrt{L_H^2 + \frac{h_{eq}^2}{9}} \cong \frac{h_{eq}}{2}$	$L_1 \cong \frac{h_{eq}}{2}$
	$L_f = L_L + L_1$	$L_f = \sqrt{L_L^2 + \left( L_H - \frac{h_{eq}}{3} \right)^2} + L_1$
$h_{eq} < 1,25 w_t$	wall above	no wall above or $h_{eq} > 1,25 w_t$

Figure B.2 — Flame dimensions, no through draught

(4) The flame width is the window width (see Figure B.2).

(5) The flame depth is 2/3 of the window height:  $2/3 h_{eq}$  (see Figure B.2).

(6) The horizontal projection of flames:

– in case of a wall existing above the window, is given by:

$$L_H = h_{eq}/3 \quad \text{if } h_{eq} \leq 1,25 w_t \quad (\text{B.8})$$

$$L_H = 0,3 h_{eq} (h_{eq} / w_t)^{0,54} \quad \text{if } h_{eq} > 1,25 w_t \text{ and distance to any other window } > 4 w_t \quad (\text{B.9})$$

$$L_H = 0,454 h_{eq} (h_{eq} / 2w_t)^{0,54} \quad \text{in other cases} \quad (\text{B.10})$$

– in case of a wall not existing above the window, is given by:

$$L_H = 0,6 h_{eq} (L_L / h_{eq})^{1/3} \quad (\text{B.11})$$

(7) The flame length along axis is given by:

when  $L_L > 0$

$$L_f = L_L + h_{eq}/2 \quad \text{if wall exist above window or if } h_{eq} \leq 1,25 w_t \quad (\text{B.12})$$

$$L_f = (L_L^2 + (L_H - h_{eq}/3)^2)^{1/2} + h_{eq}/2 \quad \text{if no wall exist above window or if } h_{eq} > 1,25 w_t \quad (\text{B.13})$$

when  $L_L = 0$ , then  $L_f = 0$

(8) The flame temperature at the window is given by:

$$T_w = 520 / (1 - 0,4725 (L_f \cdot w_t / Q)) + T_0 \quad [\text{K}] \quad (\text{B.14})$$

with  $L_f \cdot w_t / Q < 1$

(9) The emissivity of flames at the window may be taken as  $\varepsilon_f = 1,0$

(10) The flame temperature along the axis is given by:

$$T_z = (T_w - T_0) (1 - 0,4725 (L_x \cdot w_t / Q)) + T_0 \quad [\text{K}] \quad (\text{B.15})$$

with

$$L_x \cdot w_t / Q < 1$$

$L_x$  is the axis length from the window to the point where the calculation is made

(11) The emissivity of flames may be taken as:

$$\varepsilon_f = 1 - e^{-0,3d_f} \quad (\text{B.16})$$

where  $d_f$  is the flame thickness [m]

(12) The convective heat transfer coefficient is given by:

$$\alpha_c = 4,67 (1/d_{eq})^{0,4} (Q/A_v)^{0,6} \quad (\text{B.17})$$

(13) If an awning or balcony (with horizontal projection:  $W_a$ ) is located at the level of the top of the window on its whole width (see Figure B.3), for the wall above the window and  $h_{eq} \leq 1,25 w_t$ , the height and horizontal projection of the flame should be modified as follows:

- the flame height  $L_L$  given in (3) is decreased by  $W_a (1 + \sqrt{2})$ ;
- the horizontal projection of the flame  $L_H$  given in (6), is increased by  $W_a$ .

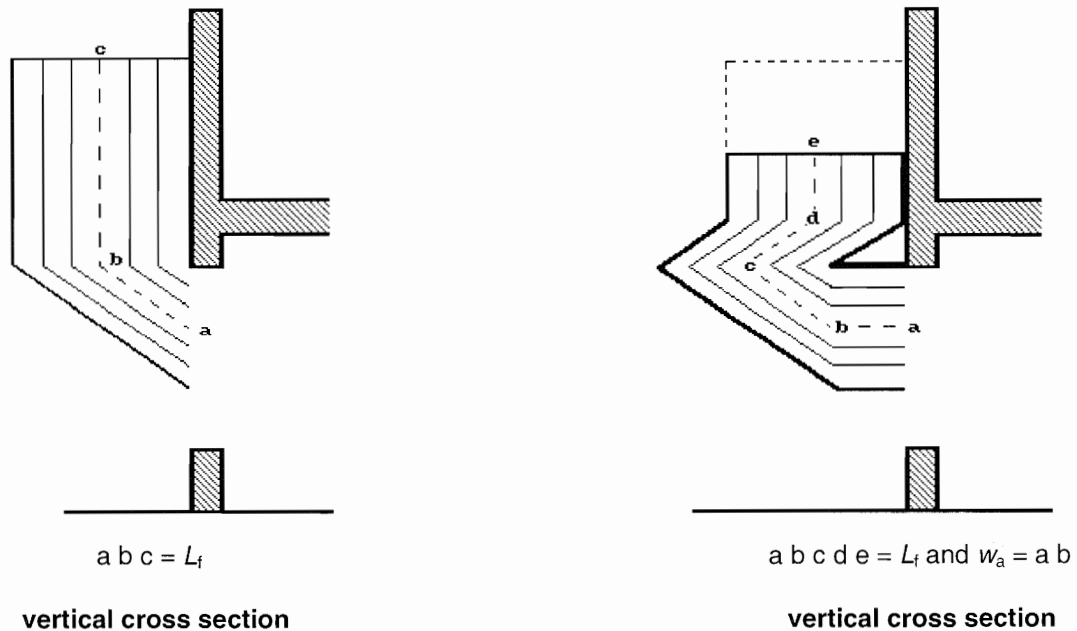


Figure B.3 — Deflection of flame by balcony

(14) With the same conditions for awning or balcony as mentioned in (13), in the case of no wall above the window or  $h_{eq} > 1,25 w_t$ , the height and horizontal projection of the flame should be modified as follows:

- the flame height  $L_L$  given in (3) is decreased by  $W_a$ ;
- the horizontal projection of the flame  $L_H$ , obtained in (6) with the above mentioned value of  $L_L$  is increased by  $W_a$ .

#### B.4.2 Forced draught

(1) The rate of burning or the rate of heat release is given by:

$$Q = (A_f \cdot q_{f,d}) / \tau_f \quad \text{[MW]} \quad \text{(B.18)}$$


(2) The temperature of the fire compartment is given by:

$$\boxed{\text{AC1}} \quad T_f = 1\,200 (1 - e^{-0,00228 \cdot Q}) + T_0 \quad \boxed{\text{AC1}} \quad \text{(B.19)}$$

(3) The flame height (see Figure B.4) is given by:

$$L_L = \left( 1,366 \left( \frac{1}{u} \right)^{0,43} \frac{Q}{A_v^{1/2}} \right) - h_{eq} \quad \text{(B.20)}$$

NOTE With  $u = 6 \text{ m/s}$ ,  $L_L \approx 0,628 \ Q / A_v^{1/2} - h_{eq}$

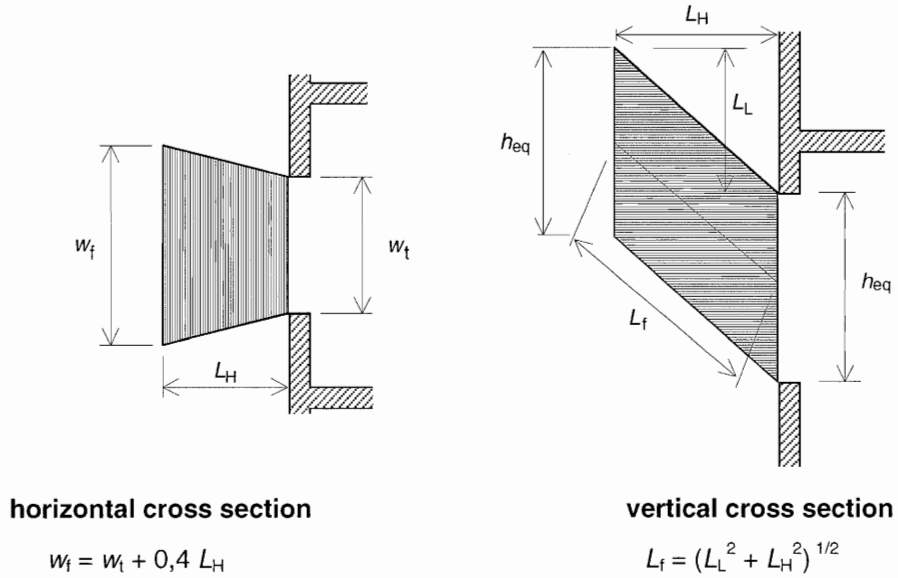

**Figure B.4 — Flame dimensions, through or forced draught**

(4) The horizontal projection of flames is given by:

$$L_H = 0,605 \ (u^2 / h_{eq})^{0,22} \ (L_L + h_{eq}) \quad (\text{B.21})$$

NOTE With  $u = 6 \text{ m/s}$ ,  $L_H = 1,33 \ (L_L + h_{eq}) / h_{eq}^{0,22}$

(5) The flame width is given by:

$$w_f = w_t + 0,4 \ L_H \quad (\text{B.22})$$

(6) The flame length along axis is given by:

$$L_f = (L_L^2 + L_H^2)^{1/2} \quad (\text{B.23})$$

(7) The flame temperature at the window is given by:

$$T_w = 520 / (1 - 0,3325 \ L_f \ (A_v)^{1/2} / Q) + T_0 \quad [\text{K}] \quad (\text{B.24})$$

with  $L_f \ (A_v)^{1/2} / Q < 1$

(8) The emissivity of flames at the window may be taken as  $\epsilon_f = 1,0$

(9) The flame temperature along the axis is given by:

$$T_z = \left( 1 - 0,3325 \frac{L_x \ (A_v)^{1/2}}{Q} \right) (T_w - T_0) + T_0 \quad [\text{K}] \quad (\text{B.25})$$

where

$L_x$  is the axis length from the window to the point where the calculation is made



(10) The emissivity of flames may be taken as:

$$\varepsilon_f = 1 - e^{-0,3d_f} \quad (\text{B.26})$$

where  $d_f$  is the flame thickness [m]

(11) The convective heat transfer coefficient is given by:

$$\alpha_c = 9,8 (1 / d_{\text{eq}})^{0,4} ( Q/(17,5 A_v) + u/1,6 )^{0,6} \quad (\text{B.27})$$

NOTE With  $u = 6$  m/s the convective heat transfer coefficient is given by:

$$\alpha_c = 9,8 ( 1/d_{\text{eq}} )^{0,4} ( Q/(17,5A_v) + 3,75 )^{0,6}$$

(12) Regarding the effects of balconies or awnings, see Figure B.5, the flame trajectory, after being deflected horizontally by a balcony or awning, is the same as before, i.e. displaced outwards by the depth of the balcony, but with a flame length  $L_f$  unchanged.

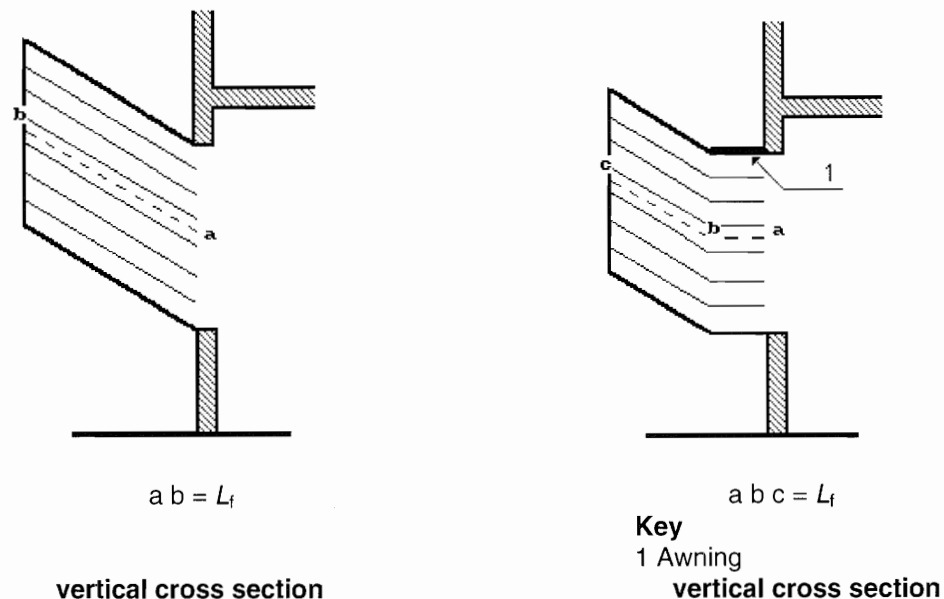


Figure B.5 — Deflection of flame by awning

## B.5 Overall configuration factors

(1) The overall configuration factor  $\Phi_f$  of a member for radiative heat transfer from an opening should be determined from:

$$\Phi_f = \frac{(C_1 \Phi_{f,1} + C_2 \Phi_{f,2}) d_1 + (C_3 \Phi_{f,3} + C_4 \Phi_{f,4}) d_2}{(C_1 + C_2) d_1 + (C_3 + C_4) d_2} \quad (\text{B.28})$$

where

$\Phi_{f,i}$  is the configuration factor of member face  $i$  for that opening, see annex G;

$d_i$  is the cross-sectional dimension of member face  $i$ ;

$C_i$  is the protection coefficient of member face  $i$  as follows:

- for a protected face:  $C_i = 0$
- for an unprotected face:  $C_i = 1$

(2) The configuration factor  $\Phi_{f,i}$  for a member face from which the opening is not visible should be taken as zero.

(3) The overall configuration factor  $\Phi_z$  of a member for radiative heat transfer from a flame should be determined from:

$$\Phi_z = \frac{(C_1 \Phi_{z,1} + C_2 \Phi_{z,2}) d_1 + (C_3 \Phi_{z,3} + C_4 \Phi_{z,4}) d_2}{(C_1 + C_2) d_1 + (C_3 + C_4) d_2} \quad (\text{B.29})$$

where

$\Phi_{z,i}$  is the configuration factor of member face  $i$  for that flame, see annex G.

(4) The configuration factors  $\Phi_{z,i}$  of individual member faces for radiative heat transfer from flames may be based on equivalent rectangular flame dimensions. The dimensions and locations of equivalent rectangles representing the front and sides of a flame for this purpose should be determined as given in annex G. For all other purposes, the flame dimensions given in B.4 of this annex should be used.

## Annex C (informative)

### Localised fires

(1) The thermal action of a localised fire can be assessed by using the expression given in this annex. Differences have to be made regarding the relative height of the flame to the ceiling.

(2) The heat flux from a localised fire to a structural element should be calculated with expression (3.1), and based on a configuration factor established according to annex G.

(3) The flame lengths  $L_f$  of a localised fire (see Figure C.1) is given by:

$$L_f = -1,02 D + 0,0148 Q^{2/5} \quad [\text{m}] \quad (\text{C.1})$$

(4) When the flame is not impacting the ceiling of a compartment ( $L_f < H$ ; see Figure C.1) or in case of fire in open air, the temperature  $\theta_{(z)}$  in the plume along the symmetrical vertical flame axis is given by:

$$\theta_{(z)} = 20 + 0,25 Q_c^{2/3} (z - z_0)^{-5/3} \leq 900 \quad [^\circ\text{C}] \quad (\text{C.2})$$

where

$D$  is the diameter of the fire [m], see Figure C.1

$Q$  is the rate of heat release [W] of the fire according to E.4

$Q_c$  is the convective part of the rate of heat release [W], with  $Q_c = 0,8 Q$  by default

$z$  is the height [m] along the flame axis, see Figure C.1

$H$  is the distance [m] between the fire source and the ceiling, see Figure C.1

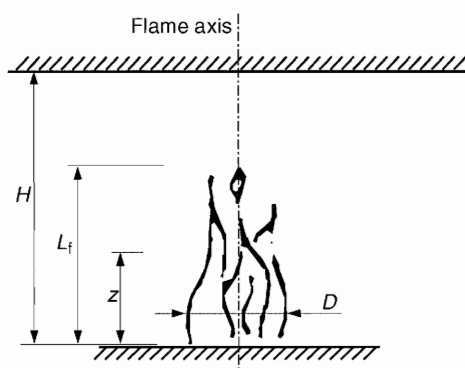


Figure C.1

(5) The virtual origin  $z_0$  of the axis is given by:

$$z_0 = -1,02 D + 0,00524 Q^{2/5} \quad [\text{m}] \quad (\text{C.3})$$

(6) When the flame is impacting the ceiling ( $L_f \geq H$ ; see Figure C.2) the heat flux  $\dot{h}$  [ $\text{W}/\text{m}^2$ ] received by the fire exposed unit surface area at the level of the ceiling is given by:

$$\begin{aligned} \dot{h} &= 100\,000 && \text{if } y \leq 0,30 \\ \dot{h} &= 136\,300 \text{ to } 121\,000 y && \text{if } 0,30 < y < 1,0 \\ \dot{h} &= 15\,000 y^{3,7} && \text{if } y \geq 1,0 \end{aligned} \quad (\text{C.4})$$

where

$y$  is a parameter [-] given by:  $y = \frac{r+H+z'}{L_h+H+z'}$

$r$  is the horizontal distance [m] between the vertical axis of the fire and the point along the ceiling where the thermal flux is calculated, see Figure C.2

$H$  is the distance [m] between the fire source and the ceiling, see Figure C.2

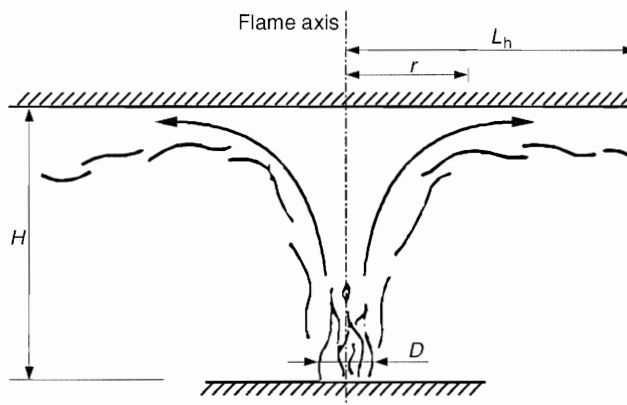


Figure C.2

(7)  $L_h$  is the horizontal flame length (see Figure C.2) given by the following relation:

$$L_h = (2,9 H (Q_H^*)^{0,33}) - H \quad [\text{m}] \quad (\text{C.5})$$

(8)  $Q_H^*$  is a non-dimensional rate of heat release given by:

$$Q_H^* = Q / (1,11 \cdot 10^6 \cdot H^{2,5}) \quad [-] \quad (\text{C.6})$$

(9)  $z'$  is the vertical position of the virtual heat source [m] and is given by:

$$\begin{aligned} z' &= 2,4 D (Q_D^{*2/5} - Q_D^{*2/3}) \quad \text{when } Q_D^* < 1,0 \\ z' &= 2,4 D (1,0 - Q_D^{*2/5}) \quad \text{when } Q_D^* \geq 1,0 \end{aligned} \quad (\text{C.7})$$

where

$$Q_D^* = Q / (1,11 \cdot 10^6 \cdot D^{2,5}) \quad [-] \quad (C.8)$$

(10) The net heat flux  $\dot{h}_{\text{net}}$  received by the fire exposed unit surface area at the level of the ceiling, is given by :

$$\dot{h}_{\text{net}} = \dot{h} - \alpha_c \cdot (\Theta_m - 20) - \Phi \cdot \varepsilon_m \cdot \varepsilon_f \cdot \sigma \cdot [(\Theta_m + 273)^4 - (293)^4] \quad (C.9)$$

where the various coefficients depend on expressions (3.2), (3.3) and (C.4).

(11) The rules given in (3) to (10) inclusive are valid if the following conditions are met:

- the diameter of the fire is limited by  $D \leq 10$  m;
- the rate of heat release of the fire is limited by  $Q \leq 50$  MW.

(12) In case of several separate localised fires, expression (C.4) may be used in order to get the different individual heat fluxes  $\dot{h}_1, \dot{h}_2 \dots$  received by the fire exposed unit surface area at the level of the ceiling. The total heat flux may be taken as:

$$\dot{h}_{\text{tot}} = \dot{h}_1 + \dot{h}_2 \dots \leq 100\,000 \quad [\text{W/m}^2] \quad (C.10)$$

## Annex D (informative)

### Advanced fire models

#### D.1 One-zone models

(1) A one-zone model should apply for post-flashover conditions. Homogeneous temperature, density, internal energy and pressure of the gas are assumed in the compartment.

(2) The temperature should be calculated considering:

- the resolution of mass conservation and energy conservation equations;
- the exchange of mass between the internal gas, the external gas (through openings) and the fire (pyrolysis rate);
- the exchange of energy between the fire, internal gas, walls and openings.

(3) The ideal gas law considered is:

$$P_{\text{int}} = \rho_g R T_g \quad [\text{N/m}^2] \quad (\text{D.1})$$

(4) The mass balance of the compartment gases is written as

$$\frac{dm}{dt} = \dot{m}_{\text{in}} - \dot{m}_{\text{out}} + \dot{m}_{\text{fi}} \quad [\text{kg/s}] \quad (\text{D.2})$$

where

$\frac{dm}{dt}$  is the rate of change of gas mass in the fire compartment

$\dot{m}_{\text{out}}$  is the rate of gas mass going out through the openings

$\dot{m}_{\text{in}}$  is the rate of gas mass coming in through the openings

$\dot{m}_{\text{fi}}$  is the rate of pyrolysis products generated

(5) The rate of change of gas mass and the rate of pyrolysis may be neglected. Thus

$$\dot{m}_{\text{in}} = \dot{m}_{\text{out}} \quad (\text{D.3})$$

These mass flows may be calculated based on static pressure due to density differences between air at ambient and high temperatures, respectively.

(6) The energy balance of the gases in the fire compartment may be taken as:

$$\frac{dE_g}{dt} = Q - Q_{\text{out}} + Q_{\text{in}} - Q_{\text{wall}} - Q_{\text{rad}} \quad [\text{W}] \quad (\text{D.4})$$

where

$E_g$	is the internal energy of gas	[J]
$Q$	is the rate of heat release of the fire	[W]
$Q_{out}$	$= \dot{m}_{out} c T_f$	
$Q_{in}$	$= \dot{m}_{in} c T_{amb}$	
$Q_{wall}$	$= (A_t - A_{h,v}) \dot{h}_{net}$ , is the loss of energy to the enclosure surfaces	
$Q_{rad}$	$= A_{h,v} \sigma T_f^4$ , is the loss of energy by radiation through the openings	
with:		
$c$	is the specific heat	[J/kgK]
$\dot{h}_{net}$	is given by expression (3.1)	
$\dot{m}$	is the gas mass rate	[kg/s]
$T$	is the temperature	[K]

## D.2 Two-zone models

(1) A two-zone model is based on the assumption of accumulation of combustion products in a layer beneath the ceiling, with a horizontal interface. Different zones are defined: the upper layer, the lower layer, the fire and its plume, the external gas and walls.

(2) In the upper layer, uniform characteristics of the gas may be assumed.

(3) The exchanges of mass, energy and chemical substance may be calculated between these different zones.

(4) In a given fire compartment with a uniformly distributed fire load, a two-zone fire model may develop into a one-zone fire in one of the following situations:

- if the gas temperature of the upper layer gets higher than 500 °C,
- if the upper layer is growing so to cover 80% of the compartment height.

## D.3 Computational fluid dynamic models

(1) A computational fluid dynamic model may be used to solve numerically the partial differential equations giving, in all points of the compartment, the thermo-dynamic and aero-dynamic variables.

NOTE Computational fluid dynamic models, or CFD, analyse systems involving fluid flow, heat transfer and associated phenomena by solving the fundamental equations of the fluid flow. These equations represent the mathematical statements of the conservation laws of physics:

- the mass of a fluid is conserved;
- the rate of change of momentum equals the sum of the forces on a fluid particle (Newton's second law);
- the rate of change of energy is equal to the sum of the rate of heat increase and the rate of work done on a fluid particle (first law of thermodynamics).

## Annex E (informative)

### Fire load densities

#### E.1 General

(1) The fire load density used in calculations should be a design value, either based on measurements or in special cases based on fire resistance requirements given in national regulations.

(2) The design value may be determined:

- from a national fire load classification of occupancies; and/or
- specific for an individual project by performing a fire load survey.

(3) The design value of the fire load  $q_{f,d}$  is defined as:

$$q_{f,d} = q_{f,k} \cdot m \cdot \delta_{q1} \cdot \delta_{q2} \cdot \delta_n \quad [\text{MJ/m}^2] \quad (\text{E.1})$$

where

$m$  is the combustion factor (see E.3)

$\delta_{q1}$  is a factor taking into account the fire activation risk due to the size of the compartment (see Table E.1)

$\delta_{q2}$  is a factor taking into account the fire activation risk due to the type of occupancy (see Table E.1)

$\delta_n = \prod_{i=1}^{10} \delta_{ni}$  is a factor taking into account the different active fire fighting measures  $i$  (sprinkler, detection, automatic alarm transmission, firemen ...). These active measures are generally imposed for life safety reason (see Table E.2 and clauses (4) and (5)).

$q_{f,k}$  is the characteristic fire load density per unit floor area  $[\text{MJ/m}^2]$  (see f.i. Table E.4)

**Table E.1 — Factors  $\delta_{q1}$ ,  $\delta_{q2}$**

Compartment floor area $A_f$ [ $\text{m}^2$ ]	Danger of Fire Activation $\delta_{q1}$	Danger of Fire Activation $\delta_{q2}$	Examples of Occupancies
25	1,10	0,78	artgallery, museum, swimming pool
250	1,50	1,00	offices, residence, hotel, paper industry
2 500	1,90	1,22	manufactory for machinery & engines
5 000	2,00	1,44	chemical laboratory, painting workshop
10 000	2,13	1,66	manufactory of fireworks or paints



Table E.2 — Factors  $\delta_{ni}$

$\delta_{ni}$ Function of Active Fire Fighting Measures									
Automatic Fire Suppression		Automatic Fire Detection			Manual Fire Suppression				
Automatic Water Extinguishing System $\delta_{n1}$	Independent Water Supplies 0   1   2 $\delta_{n2}$	Automatic fire Detection & Alarm		Automatic Alarm Transmission to Fire Brigade $\delta_{n5}$	Work Fire Brigade $\delta_{n6}$	Off Site Fire Brigade $\delta_{n7}$	Safe Access Routes $\delta_{n8}$	Fire Fighting Devices $\delta_{n9}$	Smoke Exhaust System $\delta_{n10}$
		by Heat $\delta_{n3}$	by Smoke $\delta_{n4}$						
0,61	1,0   0,87   0,7	0,87 or 0,73		0,87	0,61 or 0,78		0,9 or 1 or 1,5	1,0 or 1,5	1,0 or 1,5

(4) For the normal fire fighting measures, which should almost always be present, such as the safe access routes, fire fighting devices, and smoke exhaust systems in staircases, the  $\delta_{ni}$  values of Table E.2 should be taken as 1,0. However, if these fire fighting measures have not been foreseen, the corresponding  $\delta_{ni}$  value should be taken as 1,5.

(5) If staircases are put under overpressure in case of fire alarm, the factor  $\delta_{n8}$  of Table E.2 may be taken as 0,9.

(6) The preceding approach is based on the assumption that the requirements in the relevant European Standards on sprinklers, detection, alarm, smoke exhaust systems are met, see also 1.3. However local circumstances may influence the numbers given in Table E.2. Reference is made to the Background Document CEN/TC250/SC1/N300A.

## E.2 Determination of fire load densities

### E.2.1 General

(1) The fire load should consist of all combustible building contents and the relevant combustible parts of the construction, including linings and finishings. Combustible parts of the combustion which do not char during the fire need not to be taken into account.

(2) The following clauses apply for the determination of fire load densities:

- from a fire load classification of occupancies (see E.2.5); and/or
- specific for an individual project (see E.2.6).

(3) Where fire load densities are determined from a fire load classification of occupancies, fire loads are distinguished as:

- fire loads from the occupancy, given by the classification;
- fire loads from the building (construction elements, linings and finishings) which are generally not included in the classification and are then determined according to the following clauses, as relevant.

### E.2.2 Definitions

(1) The characteristic fire load is defined as:

$$Q_{fi,k} = \sum M_{k,i} \cdot H_{ui} \cdot \Psi_i = \sum Q_{fi,k,i} \quad [\text{MJ}] \quad (\text{E.2})$$

where

$M_{k,i}$  is the amount of combustible material [kg], according to (3) and (4)

$H_{ui}$  is the net calorific value [MJ/kg], see (E.2.4)

$[\Psi_1]$  is the optional factor for assessing protected fire loads, see (E.2.3)

(2) The characteristic fire load density  $q_{f,k}$  per unit area is defined as:

$$q_{f,k} = Q_{f,k} / A \quad [\text{MJ/m}^2] \quad (\text{E.3})$$

where

$A$  is the floor area ( $A_f$ ) of the fire compartment or reference space, or inner surface area ( $A_i$ ) of the fire compartment, giving  $q_{f,k}$  or  $q_{t,k}$

(3) Permanent fire loads, which are not expected to vary during the service life of a structure, should be introduced by their expected values resulting from the survey.

(4) Variable fire loads, which may vary during the service life of a structure, should be represented by values, which are expected not to be exceeded during 80 % of time.

### E.2.3 Protected fire loads

(1) Fire loads in containments which are designed to survive fire exposure need not be considered.

(2) Fire loads in non-combustible containments with no specific fire design, but which remain intact during fire exposure, may be considered as follows:

The largest fire load, but at least 10 % of the protected fire loads, is associated with  $\Psi_1 = 1,0$ .

If this fire load plus the unprotected fire loads are not sufficient to heat the remaining protected fire loads beyond ignition temperature, then the remaining protected fire loads may be associated with  $\Psi_1 = 0,0$ .

Otherwise,  $\Psi_1$  values need to be assessed individually.

### E.2.4 Net calorific values

(1) Net calorific values should be determined according to EN ISO 1716:2002.

(2) The moisture content of materials may be taken into account as follows:

$$H_u = H_{u0} (1 - 0,01 u) - 0,025 u \quad [\text{MJ/kg}] \quad (\text{E.4})$$

where

$u$  is the moisture content expressed as percentage of dry weight

$H_{u0}$  is the net calorific value of dry materials

(3) Net calorific values of some solids, liquids and gases are given in Table E.3.

Table E.3 — Net calorific values  $H_u$  [MJ/kg] of combustible materials for calculation of fire loads

<b>Solids</b>	
Wood	17,5
Other cellulosic materials <ul style="list-style-type: none"> <li>• Clothes</li> <li>• Cork</li> <li>• Cotton</li> <li>• Paper, cardboard</li> <li>• Silk</li> <li>• Straw</li> <li>• Wool</li> </ul>	20
Carbon <ul style="list-style-type: none"> <li>• Anthracit</li> <li>• Charcoal</li> <li>• Coal</li> </ul>	30
<b>Chemicals</b>	
Paraffin series <ul style="list-style-type: none"> <li>• Methane</li> <li>• Ethane</li> <li>• Propane</li> <li>• Butane</li> </ul>	50
Olefin series <ul style="list-style-type: none"> <li>• Ethylene</li> <li>• Propylen</li> <li>• Butene</li> </ul>	45
Aromatic series <ul style="list-style-type: none"> <li>• Benzene</li> <li>• Toluene</li> </ul>	40
Alcohols <ul style="list-style-type: none"> <li>• Methanol</li> <li>• Ethanol</li> <li>• Ethyl alcohol</li> </ul>	30
Fuels <ul style="list-style-type: none"> <li>• Gasoline, petroleum</li> <li>• Diesel</li> </ul>	45
Pure hydrocarbons plastics <ul style="list-style-type: none"> <li>• Polyethylene</li> <li>• Polystyrene</li> <li>• Polypropylene</li> </ul>	40
<b>Other products</b>	
ABS (plastic)	35
Polyester (plastic)	30
Polyisocyanerat and polyurethane (plastics)	25
Polyvinylchloride, PVC (plastic)	20
Bitumen, asphalt	40
Leather	20
Linoleum	20
Rubber tyre	30
NOTE The values given in this table are not applicable for calculating energy content of fuels.	

### E.2.5 Fire load classification of occupancies

(1) The fire load densities should be classified according to occupancy, be related to the floor area, and be used as characteristic fire load densities  $q_{f,k}$  [MJ/m<sup>2</sup>], as given in Table E.4.

**Table E.4 — Fire load densities  $q_{f,k}$  [MJ/m<sup>2</sup>] for different occupancies**

Occupancy	Average	80% Fractile
Dwelling	780	948
Hospital (room)	230	280
Hotel (room)	310	377
Library	1 500	1 824
Office	420	511
Classroom of a school	285	347
Shopping centre	600	730
Theatre (cinema)	300	365
Transport (public space)	100	122
NOTE Gumbel distribution is assumed for the 80 % fractile.		

(2) The values of the fire load density  $q_{f,k}$  given in Table E.4 are valid in case of a factor  $\delta_{q2}$  equal to 1,0 (see Table E.1).

(3) The fire loads in Table E.4 are valid for ordinary compartments in connection with the here given occupancies. Special rooms are considered according to E.2.2.

(4) Fire loads from the building (construction elements, linings and finishings) should be determined according to E.2.2. These should be added to the fire load densities of (1) if relevant.

### E.2.6 Individual assessment of fire load densities

(1) In the absence of occupancy classes, fire load densities may be specifically determined for an individual project by performing a survey of fire loads from the occupancy.

(2) The fire loads and their local arrangement should be estimated considering the intended use, furnishing and installations, variations with time, unfavourable trends and possible modifications of occupancy.

(3) Where available, a survey should be performed in a comparable existing project, such that only possible differences between the intended and existing project need to be specified by the client.

## E.3 Combustion behaviour

(1) The combustion behaviour should be considered in function of the occupancy and of the type of fire load.

(2) For mainly cellulosic materials, the combustion factor may be assumed as  $m = 0,8$ .

#### E.4 Rate of heat release $Q$

(1) The growing phase may be defined by the expression:

$$Q = 10^6 \left( \frac{t}{t_\alpha} \right)^2 \quad (\text{E.5})$$

where

$Q$  is the rate of heat release in [W]

$t$  is the time in [s]

$t_\alpha$  is the time needed to reach a rate of heat release of 1 MW.

(2) The parameter  $t_\alpha$  and the maximum rate of heat release  $RHR_f$ , for different occupancies, are given in Table E.5

**Table E.5 — Fire growth rate and  $RHR_f$  for different occupancies**

Max Rate of heat release $RHR_f$			
Occupancy	Fire growth rate	$t_\alpha$ [s]	$RHR_f$ [kW/m <sup>2</sup> ]
Dwelling	Medium	300	250
Hospital (room)	Medium	300	250
Hotel (room)	Medium	300	250
Library	Fast	150	500
Office	Medium	300	250
Classroom of a school	Medium	300	250
Shopping centre	Fast	150	250
Theatre (cinema)	Fast	150	500
Transport (public space)	Slow	600	250

(3) The values of the fire growth rate and  $RHR_f$  according to Table E.5 are valid in case of a factor  $\delta_{q2}$  equal to 1,0 (see Table E.1).

(4) For an ultra-fast fire spread,  $t_\alpha$  corresponds to 75 s.

(5) The growing phase is limited by an horizontal plateau corresponding to the stationary state and to a value of  $Q$  given by  $(RHR_f \cdot A_{fi})$

where

$A_{fi}$  is the maximum area of the fire [m<sup>2</sup>] which is the fire compartment in case of uniformly distributed fire load but which may be smaller in case of a localised fire.

$RHR_f$  is the maximum rate of heat release produced by 1 m<sup>2</sup> of fire in case of fuel controlled conditions [kW/m<sup>2</sup>] (see Table E.5).

(6) The horizontal plateau is limited by the decay phase which starts when 70 % of the total fire load has been consumed.

(7) The decay phase may be assumed to be a linear decrease starting when 70 % of the fire load has been burnt and completed when the fire load has been completely burnt.

(8) If the fire is ventilation controlled, this plateau level has to be reduced following the available oxygen content, either automatically in case of the use of a computer program based on one zone model or by the simplified expression:

$$Q_{\max} = 0,10 \cdot m \cdot H_u \cdot A_v \cdot \sqrt{h_{\text{eq}}} \quad [\text{MW}] \quad (\text{E.6})$$

where

$A_v$  is the opening area [ $\text{m}^2$ ]

$h_{\text{eq}}$  is the mean height of the openings [m]

$H_u$  is the net calorific value of wood with  $H_u = 17,5$  MJ/kg

$m$  is the combustion factor with  $m = 0,8$

(9) When the maximum level of the rate of heat release is reduced in case of ventilation controlled condition, the curve of the rate of heat release has to be extended to correspond to the available energy given by the fire load. If the curve is not extended, it is then assumed that there is external burning, which induces a lower gas temperature in the compartment.

## Annex F (informative)

### Equivalent time of fire exposure

(1) The following approach may be used where the design of members is based on tabulated data or other simplified rules, related to the standard fire exposure.

NOTE The method given in this annex is material dependent. It is not applicable to composite steel and concrete or timber constructions.

(2) If fire load densities are specified without specific consideration of the combustion behaviour (see annex E), then this approach should be limited to fire compartments with mainly cellulosic type fire loads.

(3) The equivalent time of standard fire exposure is defined by:

$$t_{e,d} = (q_{f,d} \cdot k_b \cdot w_f) k_c \quad \text{or} \quad t_{e,d} = (q_{f,d} \cdot k_b \cdot w_f) k_c \quad [\text{min}] \quad (\text{F.1})$$

where

$q_{f,d}$  is the design fire load density according to annex E, whereby  $q_{f,d} = q_{t,d} \cdot A_f / A_t$

$k_b$  is the conversion factor according to (4)

$w_f$  is the ventilation factor according to (5), whereby  $w_f = w_f \cdot A_f / A_t$

$k_c$  is the correction factor function of the material composing structural cross-sections and defined in Table F.1.

**Table F.1 — Correction factor  $k_c$  in order to cover various materials.  
( $O$  is the opening factor defined in annex A)**

Cross-section material	Correction factor $k_c$
Reinforced concrete	1,0
Protected steel	1,0
Not protected steel	$13,7 \cdot O$

(4) Where no detailed assessment of the thermal properties of the enclosure is made, the conversion factor  $k_b$  may be taken as:

$$k_b = 0,07 \quad [\text{min} \cdot \text{m}^2/\text{MJ}] \quad \text{when } q_d \text{ is given in } [\text{MJ}/\text{m}^2] \quad (\text{F.2})$$

otherwise  $k_b$  may be related to the thermal property  $b = \sqrt{(\rho c \lambda)}$  of the enclosure according to Table F.2. For determining  $b$  for multiple layers of material or different materials in walls, floor, ceiling, see annex A (5) and (6).

Table F.2 — Conversion factor  $k_b$  depending on the thermal properties of the enclosure

$b = \sqrt{\rho c \lambda}$ [J/m <sup>2</sup> s <sup>1/2</sup> K]	$k_b$ [min · m <sup>2</sup> /MJ]
$b > 2\,500$	0,04
$720 \leq b \leq 2\,500$	0,055
$b < 720$	0,07

(5) The ventilation factor  $w_f$  may be calculated as:

$$w_f = (6,0 / H)^{0,3} [0,62 + 90(0,4 - \alpha_v)^4 / (1 + b_v \alpha_h)] \geq 0,5 \quad [-] \quad (\text{F.3})$$

where

$\alpha_v = A_v / A_f$  is the area of vertical openings in the façade ( $A_v$ ) related to the floor area of the compartment ( $A_f$ ) where the limit  $0,025 \leq \alpha_v \leq 0,25$  should be observed

$\alpha_h = A_h / A_f$  is the area of horizontal openings in the roof ( $A_h$ ) related to the floor area of the compartment ( $A_f$ )

$$b_v = 12,5 (1 + 10 \alpha_v - \alpha_v^2) \geq 10,0$$

$H$  is the height of the fire compartment [m]

For small fire compartments [ $A_f < 100 \text{ m}^2$ ] without openings in the roof, the factor  $w_f$  may also be calculated as:

$$w_f = O^{1/2} \cdot A_f / A_t \quad (\text{F.4})$$

where

$O$  is the opening factor according to annex A

(6) It shall be verified that:

$$t_{e,d} < t_{fi,d} \quad (\text{F.5})$$

where

$t_{fi,d}$  is the design value of the standard fire resistance of the members, assessed according to the fire Parts of prEN 1992 to prEN 1996 and prEN 1999.



## Annex G (informative)

### Configuration factor

#### G.1 General

(1) The configuration factor  $\Phi$  is defined in 1.5.4.1, which in a mathematical form is given by:

$$dF_{d1-d2} = \frac{\cos \theta_1 \cos \theta_2}{\pi S_{1-2}^2} dA_2 \quad (\text{G.1})$$

The configuration factor measures the fraction of the total radiative heat leaving a given radiating surface that arrives at a given receiving surface. Its value depends on the size of the radiating surface, on the distance from the radiating surface to the receiving surface and on their relative orientation (see Figure G.1).

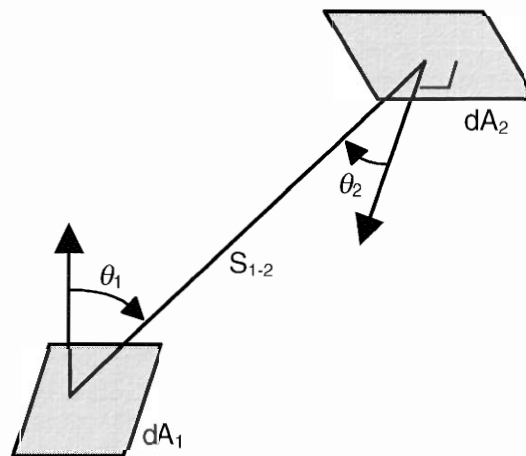


Figure G.1 — Radiative heat transfer between two infinitesimal surface areas

(2) In cases where the radiator has uniform temperature and emissivity, the definition can be simplified to : “the solid angle within which the radiating environment can be seen from a particular infinitesimal surface area, divided by  $2\pi$ .”

(3) The radiative heat transfer to an infinitesimal area of a convex member surface is determined by the position and the size of the fire only (position effect).

(4) The radiative heat transfer to an infinitesimal area of a concave member surface is determined by the position and the size of the fire (position effect) as well as by the radiation from other parts of the member (shadow effects).

(5) Upper limits for the configuration factor  $\Phi$  are given in Table G.1.

Table G.1 — Limits for configuration factor  $\Phi$

		Localised	Fully developed
position effect		$\Phi \leq 1$	$\Phi = 1$
shadow effect	convex	$\Phi = 1$	$\Phi = 1$
	concave	$\Phi \leq 1$	$\Phi \leq 1$

## G.2 Shadow effects

(1) Specific rules for quantifying the shadow effect are given in the material orientated parts of the Eurocodes.

## G.3 External members


(1) For the calculation of temperatures in external members, all radiating surfaces may be assumed to be rectangular in shape. They comprise the windows and other openings in fire compartment walls and the equivalent rectangular surfaces of flames, see annex B.

(2) In calculating the configuration factor for a given situation, a rectangular envelope should first be drawn around the cross-section of the member receiving the radiative heat transfer, as indicated in Figure G.2 (This accounts for the shadow effect in an approximate way). The value of  $\Phi$  should then be determined for the mid-point P of each face of this rectangle.

(3) The configuration factor for each receiving surface should be determined as the sum of the contributions from each of the zones on the radiating surface (normally four) that are visible from the point P on the receiving surface, as indicated in Figures G.3 and G.4. These zones should be defined relative to the point X where a horizontal line perpendicular to the receiving surface meets the plane containing the radiating surface. No contribution should be taken from zones that are not visible from the point P, such as the shaded zones in Figure G.4.

(4) If the point X lies outside the radiating surface, the effective configuration factor should be determined by adding the contributions of the two rectangles extending from X to the farther side of the radiating surface, then subtracting the contributions of the two rectangles extending from X to the nearer side of the radiating surface.

(5) The contribution of each zone should be determined as follows:

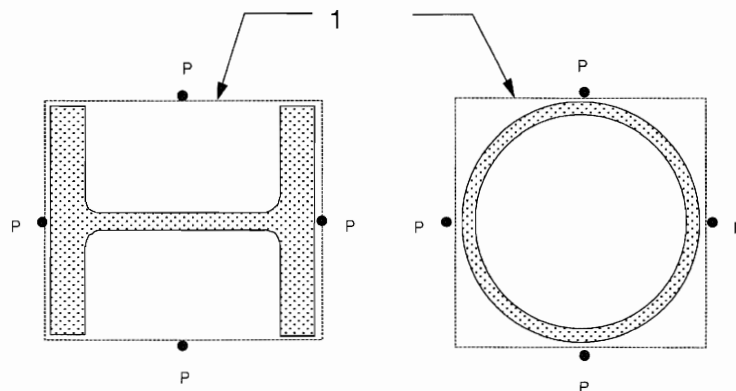

Key  
1 Envelope

Figure G.2 — Envelope of receiving surfaces

a) receiving surface parallel to radiating surface:

$$\Phi = \frac{1}{2\pi} \left[ \frac{a}{(1+a^2)^{0,5}} \tan^{-1} \left( \frac{b}{(1+a^2)^{0,5}} \right) + \frac{b}{(1+b^2)^{0,5}} \tan^{-1} \left( \frac{a}{(1+b^2)^{0,5}} \right) \right] \quad (\text{G.2})$$

where

$a = h/s$

$b = w/s$

$s$  is the distance from P to X;

$h$  is the height of the zone on the radiating surface;


$w$  is the width of that zone.

b) receiving surface perpendicular to radiating surface:

$$\Phi = \frac{1}{2\pi} \left[ \tan^{-1}(a) - \frac{1}{(1+b^2)^{0,5}} \tan^{-1} \left( \frac{a}{(1+b^2)^{0,5}} \right) \right] \quad (\text{G.3})$$

c) receiving surface in a plane at an angle  $\theta$  to the radiating surface:

$$\Phi = \frac{1}{2\pi} \left[ \tan^{-1}(a) - \frac{(1-b \cos \theta)}{(1+b^2-2b \cos \theta)^{0,5}} \tan^{-1} \left( \frac{a}{(1+b^2-2b \cos \theta)^{0,5}} \right) + \frac{a \cos \theta}{(a^2 + \sin^2 \theta)^{0,5}} \left[ \tan^{-1} \left( \frac{(b - \cos \theta)}{(a^2 + \sin^2 \theta)^{0,5}} \right) + \tan^{-1} \left( \frac{\cos \theta}{(a^2 + \sin^2 \theta)^{0,5}} \right) \right] \right] \quad (\text{G.4})$$

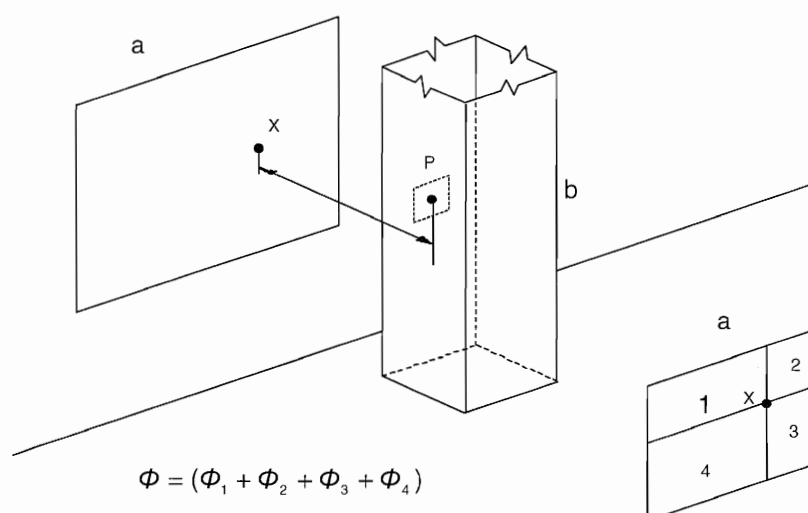


**Key**

a Radiating surface


b Receiving surface

**Figure G.3 — Receiving surface in a plane parallel to that of the radiating surface**

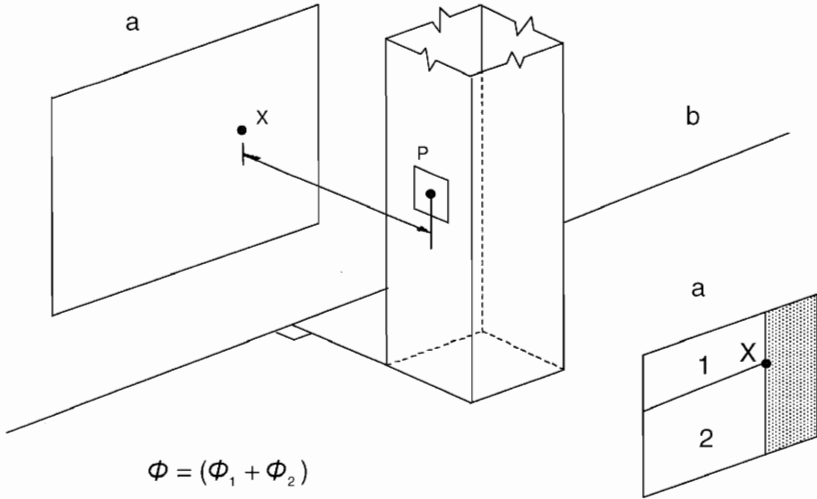

**Key**  
 a Radiating surface  
 b Receiving surface

**Figure G.4 — Receiving surface perpendicular to the plane of the radiating surface**

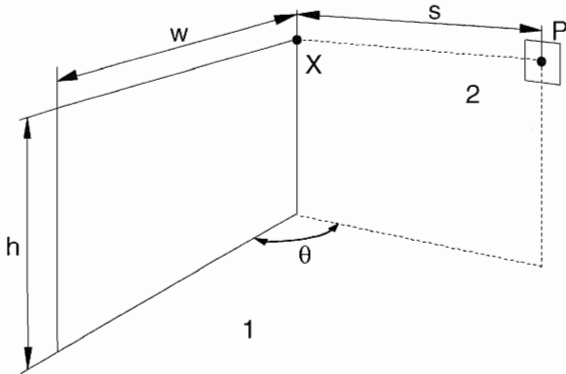

**Key**  
 1 Radiating surface  
 2 Receiving surface

**Figure G.5 — Receiving surface in a plane at an angle  $\theta$  to that of the radiating surface**

## Bibliography

EN ISO 1716:2002, *Reaction to fire tests for building products - Determination of the heat of combustion (ISO 1716:2002)*.

EN 1363-2, *Fire resistance tests - Part 2: Alternative and additional procedures*.